

# **REGULATION (EU) 2016/1447 of 26 August 2016 ESTABLISHING A NETWORK CODE ON REQUIREMENTS FOR GRID CONNECTION OF HIGH VOLTAGE DIRECT CURRENT SYSTEMS AND DIRECT CURRENT-CONNECTED POWER PARK MODULES**

The European Commission

With regard to the Energy Community Treaty,

1. The rapid completion of a fully functional and interconnected internal electricity market is essential for maintaining the security of energy supply, increasing competition and ensuring that all customers can purchase electricity at affordable prices.

2. Regulation (EC) No. 714/2009 defines the non-discriminatory rules that regulate access to the network for cross-border exchanges of electricity in order to ensure the proper functioning of the internal electricity market. In addition, Article 5 of Directive 2009/72/EC of the European Parliament and of the Council requires the Contracting Parties or, when the Contracting Parties have ensured this, the regulatory authorities to ensure, inter alia, that objective and non-discriminatory technical rules are developed, which define the minimum technical design and operational requirements for network connection. When the requirements constitute the terms and conditions for connection to national networks, Article 37 (6) of the same Directive requires regulatory authorities to be responsible for completing or approving at least the methodologies used for their calculation or determination. In order to ensure system security within the interconnected transmission system, it is essential to establish a common understanding of the requirements for HVDC systems and DC-connected power park module (direct current-connected power park modules). These requirements that contribute to maintaining, preserving and restoring system security in order to facilitate the proper functioning of the internal electricity market within and between synchronous areas and to achieve cost efficiency, should be considered as cross-border network issues and issues of market integration.

3. Harmonized rules shall be established for grid connection of HVDC systems and DC-connected power park modules, in order to provide a clear legal framework for grid connections, facilitate trade throughout the Energy Community, to maintain system security, facilitate the integration of renewable sources of electricity, increase competition and allow more efficient use of the grid and resources, for the benefit of customers.

4. The security of the system depends in part on the technical capabilities of the HVDC systems and DC-connected power park modules. Hence regular coordination at the level of transmission and distribution networks and adequate performance of equipment connected to transmission and distribution networks, with sufficient resilience to withstand disturbances and help prevent any major disruption or facilitate restoration of the system after a collapse are fundamental prerequisites.

5. The safe operation of the system is only possible if there is a close cooperation between the system operators and the owners of the HVDC systems and DC-connected power park modules. In particular, system operation under abnormal operating conditions depends on the response of HVDC systems and DC-connected power park modules to deviations from the reference values of 1 per unit (pu) of nominal voltage and frequency. In the context of system safety, HVDC grids and systems and DC-connected power park modules should be considered as one entity from a system engineering point of view, as these parts

are interdependent. Therefore, as a prerequisite for grid connection, the relevant technical requirements for HVDC systems and DC- connected power park modules must be defined.

6.Regulatory authorities must take into account the reasonable costs of system operators in implementing this regulation when setting or approving transmission or distribution tariffs or their methodologies or when approving terms and conditions for connection and access to national networks in accordance with Article 37 (1) and (6) of Directive 2009/72/EC as well as Article 14 of Regulation (EC) No. 714/2009.

7.The different synchronous systems in the Energy Community have different characteristics that must be taken into account when determining the requirements for HVDC systems and DC- connected power park modules. Therefore, it is appropriate to take regional specifics into account when determining the rules of connection to the network as required by Article 8 (6) of Regulation (EC) No. 714/2009.

8.Taking into account the need to ensure regulatory certainty, the requirements of this Regulation should only apply to new HVDC systems and new DC-connected power park modules, but should not apply to existing HVDC systems and DC- connected power park modules, which already exist or are in an advanced stage of planning, but not fully completed, unless the relevant regulatory authority or Contracting Party of the Energy Community decides otherwise, based on the development of system requirements and a full cost-benefit analysis, or where there has been substantial modernization of these facilities.

9.Due to its cross-border impact, this Regulation should aim at the same frequency requirements for all voltage levels, at least within a synchronous area. This is necessary because within a synchronous zone, a change in frequency in one Contracting Party would immediately affect and could damage equipment in all Contracting Parties of the Energy Community.

10.To ensure system security, it must be possible for HVDC systems and DC-connected power park modules in each synchronous zone of the interconnected system to remain connected to the system in the specified frequency and range.

11.Voltage ranges must be coordinated between interconnected systems, because they are crucial to ensure the planning and operation of a power system within a synchronous area. Disconnections due to voltage disturbances have an impact on neighboring systems. Failure to specify voltage ranges can lead to extensive uncertainty in system planning and operation with respect to operation beyond normal operating conditions.

12.Adequate and appropriate compliance testing should be recognized so that system operators can ensure operational security. Pursuant to Article 37(1)(b) of Directive 2009/72/EC, regulatory authorities are responsible for ensuring that system operators comply with this Regulation.

13.Regulatory authorities, Contracting Parties of the Energy Community and system operators must ensure that, in the process of drafting and approving requirements for connection to the grid, they are harmonized to the extent possible, in order to ensure full integration of the market. The established technical standards should be taken into special consideration in the design of connection requirements.

14.The process for derogating from the rules should be defined in this Regulation to take account of local circumstances, where exceptionally, for example, compliance with these rules may jeopardize the stability of the local grid or where the safe operation of an HVDC system or DC- connected power park modules may require operating conditions that are not in accordance with this Regulation.

15. In the case of DC-connected power park modules, new modules may in the future, form part of an off-shore network connected to more than one synchronous zone. In this case, certain technical requirements must be defined to maintain the security of the system and to ensure that the networking of future networks can be developed cost-effectively. However, for DC-connected power park modules, some requirements must be sought at the time they become necessary only when adapting to the equipment needed to maintain system security.

16. Therefore, DC-connected power park modules owners that are or shall be connected to a radial-connected synchronous area should have the opportunity to apply, through an expedited process, for derogations to the requirements that are only needed when power park modules are connected to a grid network and where case-by-case circumstances are considered. They must also be informed as soon as possible if they qualify for a derogation for the purposes of their investment decision.

17. Subject to approval by the relevant regulatory authority or other authority where applicable in a Contracting Party, system operators should be allowed to propose derogations for certain types of HVDC systems and DC-connected power park modules.

18. This Regulation is approved based on Regulation (EC) No. 714/2009, which complements and is an integral part of it. References in Regulation (EC) No. 714/2009 in other legal acts should be understood as stated in this Regulation.

19. The measures provided for in this Regulation are in accordance with the opinion of the Committee referred to in Article 23 (1) of Regulation (EC) No. 714/2009.

APPROVED THIS REGULATION:

**TITLE I**  
**GENERAL PROVISIONS**

**Article 1**

**Subject matter**

1.This Regulation establishes a network code which lays down the requirements for grid connections of high- voltage direct current (HVDC) systems and DC-connected power park modules. It, therefore, helps to ensure fair conditions of competition in the internal electricity market, to ensure system security and the integration of renewable electricity sources, and to facilitate Energy-Community-wide trade in electricity.

2.This regulation also lays down the obligations for ensuring that system operators make appropriate use of HVDC systems and DC-connected power park modules capabilities in a transparent and non-discriminatory manner to provide a level playing field throughout the Energy Community.

**Article 2**

**Definitions**

For the purposes of this Regulation, the definitions in Article 2 of Regulation (EC) No 714/2009, Article 2 of Commission Regulation (EU) No 2015/1222<sup>1</sup>, Article 2 of Commission Regulation (EU) 2016/1388 and Article 2 of Directive 2009/72/EC shall apply. In addition, the following definitions shall apply:

- 1) **'HVDC system'** means an electrical power system which transfers energy in the form of high-voltage direct current between two or more alternating current (AC) buses and comprises at least two HVDC converter stations with DC transmission lines or cables between the HVDC converter stations;
- 2) **'DC-connected power park module'** means a power park module that is connected via one or more HVDC interface points to one or more HVDC systems;
- 3) **'embedded HVDC system'** means an HVDC system connected within a control area that is not installed for the purpose of connecting a DC-connected power park module at the time of installation, nor installed for the purpose of connecting a demand facility
- 4) **'HVDC converter station'** means part of an HVDC system which consists of one or more HVDC converter units installed in a single location together with buildings, reactors, filters, reactive power devices, control, monitoring, protective, measuring and auxiliary equipment;
- 5) **'HVDC interface point'** means a point at which HVDC equipment is connected to an AC network, at which technical specifications affecting the performance of the equipment can be prescribed;
- 6) **'DC-connected power park module owner'** means a natural or legal entity owning a DC-connected power park module;
- 7) **'maximum HVDC active power transmission capacity'** ( $P_{max}$ ) means the maximum continuous active power which an HVDC system can exchange with the network at each connection point as

specified in the connection agreement or as agreed between the relevant system operator and the HVDC system owner;

- 8) **'minimum HVDC active power transmission capacity'** ( $P_{\min}$ ) means the minimum continuous active power which an HVDC system can exchange with the network at each connection point as specified in the connection agreement or as agreed between the relevant system operator and the HVDC system owner;
- 9) **'HVDC system maximum current'** means the highest phase current, associated with an operating point inside the U-Q/ $P_{\max}$ -profile of the HVDC converter station at maximum HVDC active power transmission capacity;
- 10) **'HVDC converter unit'** means a unit comprising one or more converter bridges, together with one or more converter transformers, reactors, converter unit control equipment, essential protective and switching devices and auxiliaries, if any, used for the conversion.

**Article 3**  
**Scope of application**

1. The requirements of this Regulation shall apply to:
  - a) HVDC systems connecting synchronous areas or control areas, including back-to-back schemes;
  - b) HVDC systems connecting power park modules to a transmission network or a distribution network, pursuant to paragraph 2;
  - c) embedded HVDC systems within one control area and connected to the transmission network; and
  - d) embedded HVDC systems within one control area and connected to the distribution network when a cross-border impact is demonstrated by the relevant transmission system operator (TSO). The relevant TSO shall consider the long-term development of the network in this assessment.
2. Relevant system operators, in coordination with relevant TSOs, shall propose to competent regulatory authorities the application of this Regulation for DC-connected power park modules with a single connection point to a transmission network or distribution network which is not part of a synchronous area for approval in accordance with Article 5. All other power park modules which are AC-collected but are DC-connected to a synchronous area are considered DC-connected power park modules and fall within the scope of this Regulation.
3. Articles 55 to 59, 67 to 72 and 82 shall not apply to HVDC systems within one control area referred to in points (c) and (d) of paragraph 1 where:
  - (a) the HVDC system has at least one HVDC converter station owned by the relevant TSO;
  - (b) the HVDC system is owned by an entity which exercises control over the relevant TSO;
  - (c) the HVDC system is owned by an entity directly or indirectly controlled by an entity which also exercises control over the relevant TSO.
4. The connection requirements for HVDC systems provided for in Title II shall apply at the AC connection points of such systems, except the requirements provided for in Article 29(4) and 29 (5) and Article 31(5), which can apply at other connection points, and Article 19(1) which may apply at the terminals of the HVDC converter station.
5. The connection requirements for DC-connected power park modules and remote-end HVDC converter stations provided for in Title III shall apply at the HVDC interface point of such systems, except the requirements provided for in Article 39(1)(a) and Article 47(2), which apply at the connection point in the synchronous area to which frequency response is being provided.
6. The relevant system operator shall refuse to allow the connection of a new HVDC system or DC-connected power park module which does not comply with the requirements set out in this Regulation and which is not covered by a derogation granted by the regulatory authority, or other

authority where applicable in a Contracting Party pursuant to Title VII. The relevant system operator shall communicate such refusal, by means of a reasoned statement in writing, to the HVDC system owner or DC-connected power park module owner and, unless specified otherwise by the regulatory authority, to the regulatory authority.

7. This Regulation shall not apply to:
  - (a) HVDC systems whose connection point is below 110 kV unless a cross-border impact is demonstrated by the relevant TSO. The relevant TSO shall consider the long-term development of the network in this assessment;
  - (b) HVDC systems or DC power park modules, connected to the transmission system and distribution systems or in parts of the transmission system or distribution systems of the islands of the Contracting Parties in the Energy Community, for which the systems are not operated synchronously with Continental Europe, Great Britain, Nordics, Ireland and Northern Ireland or in the Baltic synchronous area. <sup>2</sup>

#### **Article 4**

##### **Application to existing HVDC systems and DC-connected power park modules**

1. Except for Articles 26, 31, 33 and 50, existing HVDC systems and existing DC-connected power park modules are not subject to the requirements of this Regulation, unless:

(a) the HVDC system or DC-connected power park module has been modified to such an extent that its connection agreement must be substantially revised in accordance with the following procedure:

(i) the HVDC system or DC-connected power park module owners who intend to undertake the modernisation of a plant or replacement of equipment impacting the technical capabilities of the HVDC system or DC-connected power park module shall notify their plans to the relevant system operator in advance;

(ii) if the relevant system operator considers that the extent of the modernisation or replacement of equipment is such that a new connection agreement is required, the system operator shall notify the relevant regulatory authority or, where applicable, the Contracting Party; and

(iii) the relevant regulatory authority or, where applicable, the Contracting Party shall decide if the existing connection agreement needs to be revised or a new connection agreement is required and which requirements of this Regulation shall apply; or

2. Article 3 (7) point(b) shall not be applied based on decision 2018/04/PHLG-EnC

(b) a regulatory authority or, where applicable, a Contracting Party decides to make an existing HVDC system or existing DC-connected power park module subject to all or some of the requirements of this Regulation, following a proposal from the relevant TSO in accordance with paragraphs 3, 4 and 5.

2. For the purposes of this Regulation, an HVDC system or DC-connected power park module shall be considered existing if:

- (a) it is already connected to the network on the date of expiry of the deadline for transposition of this Regulation; or
- (b) the HVDC system owner or DC-connected power park module owner has concluded a final and binding contract for the purchase of the main generating plant or HVDC equipment by two years after the expiry of the deadline for transposition of the Regulation. The HVDC system owner or DC-connected power park module owner must notify the relevant system operator and relevant TSO of conclusion of the contract within 30 months after the expiry of the deadline for transposition of the Regulation.
- (c) The notification submitted by the HVDC system owner or DC-connected power park module owner to the relevant system operator and to the relevant TSO shall at least indicate the contract title, its date of signature and date of entry into force and the specifications of the main generating plant or HVDC equipment to be constructed, assembled or purchased.
- (d) A Contracting Party may provide that in specified circumstances the regulatory authority may determine whether the HVDC system or DC-connected power park module is to be considered an existing or new HVDC system or DC-connected power park module.

3. Following a public consultation in accordance to Article 8 and in order to address significant factual changes in circumstances, such as the evolution of system requirements including penetration of renewable energy sources, smart grids, distributed generation or demand response, the relevant TSO may propose to the regulatory authority concerned, or where applicable, to the Contracting Party to extend the application of this Regulation to existing HVDC systems and/or DC-connected power park modules. For that purpose a sound and transparent quantitative cost-benefit analysis shall be carried out, in accordance with Articles 65 and 66. The analysis shall indicate:

- (a) the costs, in regard to existing HVDC systems and DC-connected power park modules, of requiring compliance with this Regulation
- (b) the socioeconomic benefit resulting from applying the requirements set out in this Regulation; and
- (c) the potential of alternative measures to achieve the required performance.

4. Before carrying out the quantitative cost-benefit analysis referred to in paragraph 3, the relevant TSO shall:

- (a) carry out a preliminary qualitative comparison of costs and benefits;



(b) obtain approval from the relevant regulatory authority or, where applicable, the Contracting Party.

5. The relevant regulatory authority or, where applicable, the Contracting Party shall decide on the extension of the applicability of this Regulation to existing HVDC systems or DC-connected power park modules within six months of receipt of the report and the recommendation of the relevant TSO in accordance with paragraph 4 of Article 65. The decision of the regulatory authority or, where applicable, the Contracting Party shall be published.

6. The relevant TSO shall take account of the legitimate expectations of HVDC system owners and DC-connected power park modules owners as part of the assessment of the application of this Regulation to existing HVDC systems or DC-connected power park modules.

7. The relevant TSO may assess the application of some or all of the provisions of this Regulation to existing HVDC systems or DC-connected power park modules every three years in accordance with the criteria and process set out in paragraphs 3 to 5.

## **Article 5**

### **Regulatory aspects**

1. Requirements of general application to be established by relevant system operators or TSOs under this Regulation shall be subject to approval by the entity designated by the Contracting Party and be published. The designated entity shall be the regulatory authority unless otherwise provided by the Contracting Party.

2. For site specific requirements to be established by relevant system operators or TSOs under this Regulation, Contracting Parties of the Energy Community may require approval by a designated entity.

3. When applying this Regulation, Contracting Parties of the Energy Community, competent entities and system operators shall:

(a) apply the principles of proportionality and non-discrimination;

(b) ensure transparency;

(c) apply the principle of optimisation between the highest overall efficiency and lowest total costs for all parties involved;

(d) respect the responsibility assigned to the relevant TSO in order to ensure system security, including as required by national legislation;

(e) consult with relevant DSOs and take account of potential impacts on their system;

(f) take into consideration agreed European standards and technical specifications.

4.The relevant system operator or TSO shall submit a proposal for requirements of general application, or the methodology used to calculate or establish them, for approval by the competent entity within two years of expiry of the deadline for transposition of this Regulation.

5.Where this Regulation requires the relevant system operator, relevant TSO, HVDC system owner, DC- connected power park module owner and/or the distribution system operator to seek agreement, they shall endeavour to do so within six months after a first proposal has been submitted by one party to the other parties. If no agreement has been found within this timeframe, each party may request the relevant regulatory authority to issue a decision within six months

6.Competent entities shall take decisions on proposals for requirements or methodologies within six months following the receipt of such proposals.

7.If the relevant system operator or TSO deems an amendment to requirements or methodologies as provided for and approved under paragraph 1 and 2 to be necessary, the requirements provided for in paragraphs 3 to 8 shall apply to the proposed amendment. System operators and TSOs proposing an amendment shall take into account the legitimate expectations, if any, of HVDC system owners, DC-connected power park module owners, equipment manufacturers and other stakeholders based on the initially specified or agreed requirements or methodologies.

8.Any party having a complaint against a relevant system operator or TSO in relation to that relevant system operator's or TSO's obligations under this Regulation may refer the complaint to the regulatory authority which, acting as dispute settlement authority, shall issue a decision within two months after receipt of the complaint. That period may be extended by two months where additional information is sought by the regulatory authority. That extended period may be further extended with the agreement of the complainant. The regulatory authority's decision shall have binding effect unless and until overruled on appeal.

9.Where the requirements under this Regulation are to be established by a relevant system operator that is not a TSO, Contracting Parties may provide that instead the TSO be responsible for establishing the relevant requirements.

## **Article 6**

### **Multiple TSOs**

1.Where more than one TSO exists in a Contracting Party, this Regulation shall apply to all those TSOs

2.Contracting Parties may, under the national regulatory regime, provide that the responsibility of a TSO to comply with one or some or all obligations under this Regulation is assigned to one or more specific TSOs.

## **Article 7**

### **Recovery of costs**

1. The costs borne by system operators subject to network tariff regulation and stemming from the obligations laid down in this Regulation shall be assessed by the relevant regulatory authorities. Costs assessed as reasonable, efficient and proportionate shall be recovered through network tariffs or other appropriate mechanisms.

2. If requested by the relevant regulatory authorities, system operators referred to in paragraph 1 shall, within three months of the request, provide the information necessary to facilitate assessment of the costs incurred.

## **Article 8**

### **Public consultation**

1. Relevant system operators and relevant TSOs shall carry out consultation with stakeholders, including the competent authorities of each Contracting Party, on proposals to extend the applicability of this Regulation to existing HVDC systems and DC-connected power park modules, in accordance with Article 4(3), on the report prepared in accordance with Article 65(3), and the cost-benefit analysis undertaken in accordance with Article 78(2). The consultation shall last at least for a period of one month.

2. The relevant system operators or relevant TSOs shall duly take into account the views of the stakeholders resulting from the consultations prior to the submission of the draft proposal or the report or cost benefit analysis for approval by the regulatory authority or, if applicable, the Contracting Party. In all cases, a sound justification for including or not the views of the stakeholders shall be provided and published in a timely manner before, or simultaneously with, the publication of the proposal.

## **Article 9**

### **Stakeholder involvement**

1. The Energy Community Regulatory Board, in close cooperation with the European Network of Transmission System Operators for Electricity (ENTSO for Electricity), shall organise stakeholder involvement regarding the requirements for grid connection of HVDC systems and DC-connected power park modules, and other aspects of the implementation of this Regulation. This shall include regular meetings with stakeholders to identify problems and propose improvements

notably related to the requirements for grid connection of HVDC systems and DC-connected power park modules.

**Article 10**  
**Confidentiality obligations**

1. Any confidential information received, exchanged or transmitted pursuant to this Regulation shall be subject to the conditions of professional secrecy laid down in paragraphs 2, 3 and 4.

2. The obligation of professional secrecy shall apply to any persons, regulatory authorities or entities subject to the provisions of this Regulation.

3. Confidential information received by the persons, regulatory authorities or entities referred to in paragraph 2 in the course of their duties may not be divulged to any other person or authority, without prejudice to cases covered by national law, the other provisions of this Regulation or other relevant Energy Community law.

4. Without prejudice to cases covered by national or Energy Community law, regulatory authorities, entities or persons who receive confidential information pursuant to this Regulation may use it only for the purpose of carrying out their duties under this Regulation.

**TITLE II**  
**GENERAL REQUIREMENTS FOR HVDC CONNECTIONS**

**CHAPTER 1**  
**Requirements for active power control and frequency support**

**Article 11**  
**Frequency ranges**

1. An HVDC system shall be capable of staying connected to the network and remaining operable within the frequency ranges and time periods specified in Table 1, Annex I for the short circuit power range as specified in Article 32(2).

2. The relevant TSO and HVDC system owner may agree on wider frequency ranges or longer minimum times for operation if needed to preserve or to restore system security. If wider frequency ranges or longer minimum times for operation are economically and technically feasible, the HVDC system owner shall not unreasonably withhold consent.

3. Without prejudice to paragraph 1, an HVDC system shall be capable of automatic disconnection at frequencies specified by the relevant TSO

4. The relevant TSO may specify a maximum admissible active power output reduction from its operating point if the system frequency falls below 49 Hz.

#### **Article 12**

##### **Rate-of-change-of-frequency withstand capability**

1. An HVDC system shall be capable of staying connected to the network and operable if the network frequency changes at a rate between  $-2,5$  and  $+2,5$  Hz/s (measured at any point in time as an average of the rate of change of frequency for the previous 1 s)

#### **Article 13**

##### **Active power controllability, control range and ramping rate**

1. With regard to the capability of controlling the transmitted active power:

(a) an HVDC system shall be capable of adjusting the transmitted active power up to its maximum HVDC active power transmission capacity in each direction following an instruction from the relevant TSO. The relevant TSO:

(i) may specify a maximum and minimum power step size for adjusting the transmitted active power;

(ii) may specify a minimum HVDC active power transmission capacity for each direction, below which active power transmission capability is not requested; and

(iii) shall specify the maximum delay within which the HVDC system shall be capable of adjusting the transmitted active power upon receipt of request from the relevant TSO.

(b) the relevant TSO shall specify how an HVDC system shall be capable of modifying the transmitted active power in feed in case of disturbances into one or more of the AC networks to which it is connected. If the initial delay prior to the start of the change is greater than 10 milliseconds from receiving the triggering signal sent by the relevant TSO, it shall be reasonably justified by the HVDC system owner to the relevant TSO

(c) the relevant TSO may specify that an HVDC system be capable of fast active power reversal. The power reversal shall be possible from the maximum active power transmission capacity in one direction to the maximum active power transmission capacity in the other direction as fast as technically feasible and reasonably justified by the HVDC system owner to the relevant TSOs if greater than 2 seconds.

(d)for HVDC systems linking various control areas or synchronous areas, the HVDC system shall be equipped with control functions enabling the relevant TSOs to modify the transmitted active power for the purpose of cross-border balancing.

2.An HVDC system shall be capable of adjusting the ramping rate of active power variations within its technical capabilities in accordance with instructions sent by relevant TSOs. In case of modification of active power according to points (b) and (c) of paragraph 1, there shall be no adjustment of ramping rate.

3.If specified by a relevant TSO, in coordination with adjacent TSOs, the control functions of an HVDC system shall be capable of taking automatic remedial actions including, but not limited to, stopping the ramping and blocking FSM, LFSM-O, LFSM-U and frequency control. The triggering and blocking criteria shall be specified by relevant TSO and subject to notification to the regulatory authority. The modalities of that notification shall be determined in accordance with the applicable national regulatory framework.

#### **Article 14**

##### **Synthetic inertia**

1.If specified by a relevant TSO, an HVDC system shall be capable of providing synthetic inertia in response to frequency changes, activated in low and/or high frequency regimes by rapidly adjusting the active power injected to or withdrawn from the AC network in order to limit the rate of change of frequency. The requirement shall at least take account of the results of the studies undertaken by TSOs to identify if there is a need to set out minimum inertia.

2.The principle of this control system and the associated performance parameters shall be agreed between the relevant TSO and the HVDC system owner.

#### **Article 15**

##### **Requirements relating to frequency sensitive mode, limited frequency sensitive mode over-frequency and limited frequency sensitive mode underfrequency**

1. Requirements applying to frequency sensitive mode, limited frequency sensitive mode over-frequency and limited frequency sensitive mode underfrequency shall be as set out in Annex II.

#### **Article 16**

##### **Frequency control**

1.If specified by the relevant TSO, an HVDC system shall be equipped with an independent control mode to modulate the active power output of the HVDC converter station depending on the frequencies at all connection points of the HVDC system in order to maintain stable system frequencies.

2.The relevant TSO shall specify the operating principle, the associated performance parameters and the activation criteria of the frequency control referred to in paragraph 1.

#### **Article 17**

##### **Maximum loss of active power**

1.An HVDC system shall be configured in such a way that its loss of active power injection in a synchronous area shall be limited to a value specified by the relevant TSOs for their respective load frequency control area, based on the HVDC system's impact on the power system.

2.Where an HVDC system connects two or more control areas, the relevant TSOs shall consult each other in order to set a coordinated value of the maximum loss of active power injection as referred to in paragraph 1, taking into account common mode failures.

#### **CHAPTER 2**

##### **Requirements for reactive power control and voltage support**

#### **Article 18**

##### **Voltage ranges**

1.Without prejudice to Article 25, an HVDC converter station shall be capable of staying connected to the network and capable of operating at HVDC system maximum current, within the ranges of the network voltage at the connection point, expressed by the voltage at the connection point related to reference 1 pu voltage, and the time periods specified in Tables 4 and 5, Annex III. The establishment of the reference 1 pu voltage shall be subject to coordination between the adjacent relevant system operators.

2.The HVDC system owner and the relevant system operator, in coordination with the relevant TSO, may agree on wider voltage ranges or longer minimum times for operation than those specified in paragraph 1 in order to ensure the best use of the technical capabilities of an HVDC system if needed to preserve or to restore system security. If wider voltage ranges or longer minimum times for operation are economically and technically feasible, the HVDC system owner shall not unreasonably withhold consent.

3.An HVDC converter station shall be capable of automatic disconnection at connection point voltages specified by the relevant system operator, in coordination with the relevant TSO. The terms and settings

for automatic disconnection shall be agreed between the relevant system operator, in coordination with the relevant TSO, and the HVDC system owner.

4. For connection points at reference 1 pu AC voltages not included in the scope set out in Annex III, the relevant system operator, in coordination with relevant TSOs, shall specify applicable requirements at the connection points.

5. Notwithstanding the provisions of paragraph 1, the relevant TSOs in Moldova and Ukraine shall, following consultation with relevant neighbouring TSOs, require HVDC converter stations to operate in the voltage ranges and for time periods that apply in the Continental Europe synchronous area.

## **Article 19**

### **Short circuit contribution during faults**

1. If specified by the relevant system operator, in coordination with the relevant TSO, an HVDC system shall have the capability to provide fast fault current at a connection point in case of symmetrical (3-phase) faults.

2. Where an HVDC system is required to have the capability referred to in paragraph 1, the relevant system operator, in coordination with the relevant TSO, shall specify the following:

- a) how and when a voltage deviation is to be determined as well as the end of the voltage deviation;
- b) the characteristics of the fast fault current;
- c) the timing and accuracy of the fast fault current, which may include several stages.

3. The relevant system operator, in coordination with the relevant TSO, may specify a requirement for asymmetrical current injection in the case of asymmetrical (1-phase or 2-phase) faults.

## **Article 20**

### **Reactive power capability**

1. The relevant system operator, in coordination with the relevant TSO, shall specify the reactive power capability requirements at the connection points, in the context of varying voltage. The proposal for those requirements shall include a U-Q/P<sub>max</sub>-profile, within the boundary of which the HVDC converter station shall be capable of providing reactive power at its maximum HVDC active power transmission capacity.

2. The U-Q/P<sub>max</sub>-profile referred to in paragraph 1 shall comply with the following principles:



(a) the U-Q/Pmax-profile shall not exceed the U-Q/Pmax-profile envelope represented by the inner envelope in the figure set out in Annex IV, and does not need to be rectangular;

(b) the dimensions of the U-Q/Pmax-profile envelope shall respect the values established for each synchronous area in the table set out in Annex IV. The dimensions of the profile envelope applied in Moldova and Ukraine shall correspond to the values that apply in the Continental Europe synchronous area; and

(c) the position of the U-Q/Pmax-profile envelope shall lie within the limits of the fixed outer envelope in the figure set out in Annex IV.

3. An HVDC system shall be capable of moving to any operating point within its U-Q/Pmax profile in timescales specified by the relevant system operator in coordination with the relevant TSO.

4. When operating at an active power output below the maximum HVDC active power transmission capacity ( $P < P_{max}$ ), the HVDC converter station shall be capable of operating in every possible operating point, as specified by the relevant system operator in coordination with the relevant TSO and in accordance with the reactive power capability set out by the U-Q/Pmax profile specified in paragraphs 1 to 3.

## **Article 39**

### **Frequency stability requirements**

1. With regards to frequency response:

(a) a DC-connected power park module shall be capable of receiving a fast signal from a connection point in the synchronous area to which frequency response is being provided, and be able to process this signal within 0,1 second from sending to completion of processing the signal for activation of the response. Frequency shall be measured at the connection point in the synchronous area to which frequency response is being provided;

(b) DC-connected power park modules connected via HVDC systems which connect with more than one control area shall be capable of delivering coordinated frequency control as specified by the relevant TSO.

2. With regard to frequency ranges and response:

(a) a DC-connected power park module shall be capable of staying connected to the remote-end HVDC converter station network and operating within the frequency ranges and time periods specified in Annex VI for the 50 Hz nominal system. Where a nominal frequency other than 50 Hz, or a frequency variable by design is used, subject to agreement with the relevant TSO, the applicable frequency ranges and time periods shall be specified by the relevant TSO taking into account specificities of the system and the requirements set out in Annex VI;

(b) wider frequency ranges or longer minimum times for operation can be agreed between the relevant TSO and the DC-connected power park module owner to ensure the best use of the technical capabilities of a DC-connected power park module if needed to preserve or to restore system security. If wider frequency ranges or longer minimum times for operation are

economically and technically feasible, the DC- connected power park module owner shall not unreasonably withhold consent;

- (c) while respecting the provisions of point (a) of paragraph 2, a DC-connected power park module shall be capable of automatic disconnection at specified frequencies, if specified by the relevant TSO. Terms and settings for automatic disconnection shall be agreed between the relevant TSO and the DC-connected power park module owner.

3. With regards to rate-of-change-of-frequency withstand capability, a DC-connected power park module shall be capable of staying connected to the remote-end HVDC converter station network and operable if the system frequency changes at a rate up to  $\pm 2$  Hz/s (measured at any point in time as an average of the rate of change of frequency for the previous 1 second) at the HVDC interface point of the DC-connected power park module at the remote end HVDC converter station for the 50 Hz nominal system.

4. DC-connected power park modules shall have limited frequency sensitive mode — over-frequency (LFSM-O) capability in accordance with Article 13(2) of Regulation (EU) 2016/631, subject to fast signal response as specified in paragraph 1 for the 50 Hz nominal system

5. A capability for DC-connected power park modules to maintain constant power shall be determined in accordance with Article 13(3) of Regulation (EU) 2016/631 for the 50 Hz nominal system.

6. A capability for active power controllability of DC-connected power park modules shall be determined in accordance with Article 15(2)(a) of Regulation (EU) 2016/631 for the 50 Hz nominal system. Manual control shall be possible in the case that remote automatic control devices are out of service.

7. A capability for limited frequency sensitive mode — underfrequency (LFSM-U) for a DC-connected power park module shall be determined in accordance with Article 15(2)(c) of Regulation (EU) 2016/631, subject to fast signal response as specified in paragraph 1 for the 50 Hz nominal system.

8. A capability for frequency sensitive mode for a DC-connected power park module shall be determined in accordance with Article 15(2)(d) of Regulation (EU) 2016/631, subject to a fast signal response as specified in paragraph 1 for the 50 Hz nominal system.

9. A capability for frequency restoration for a DC-connected power park module shall be determined in accordance with Article 15(2)(e) of Regulation (EU) 2016/631 for the 50 Hz nominal system.

10. Where a constant nominal frequency other than 50 Hz, a frequency variable by design or a DC system voltage is used, subject to the agreement of the relevant TSO, the capabilities listed in paragraphs 3 to 9 and the parameters associated with such capabilities shall be specified by the relevant TSO.

## **Article 40**

### **Reactive power and voltage requirements**

1. With respect to voltage ranges:

(a) a DC-connected power park module shall be capable of staying connected to the remote-end HVDC converter station network and operating within the voltage ranges (per unit), for the time periods specified in Tables 9 and 10, Annex VII. The applicable voltage range and time periods specified are selected based on the reference 1 pu voltage;

(b) wider voltage ranges or longer minimum times for operation can be agreed between the relevant system operator, the relevant TSO and the DC-connected power park module owner to ensure the best use of the technical capabilities of a DC-connected power park module if needed to preserve or to restore system security. If wider voltage ranges or longer minimum times for operation are economically and technically feasible, the DC-connected power park module owner shall not unreasonably withhold consent;

(c) for DC-connected power park modules which have an HVDC interface point to the remote-end HVDC converter station network, the relevant system operator, in coordination with the relevant TSO may specify voltages at the HVDC interface point at which a DC-connected power park module shall be capable of automatic disconnection. The terms and settings for automatic disconnection shall be agreed between the relevant system operator, the relevant TSO and the DC-connected power park module owner;

(d) for HVDC interface points at AC voltages that are not included in the scope of Annex VII, the relevant system operator, in coordination with the relevant TSO shall specify applicable requirements at the connection point;

(e) where frequencies other than nominal 50 Hz are used, subject to relevant TSO agreement, the voltage ranges and time periods specified by the relevant system operator, in coordination with the relevant TSO, shall be proportional to those in Tables 9 and 10, Annex VII.

## 2. With respect to reactive power capability for DC-connected power park modules:

(a) if the DC-connected power park module owner can obtain a bilateral agreement with the owners of the HVDC systems connecting the DC-connected power park module to a single connection point on a AC network, it shall fulfil all of the following requirements:

(i) it shall have the ability with additional plant or equipment and/or software, to meet the reactive power capabilities prescribed by the relevant system operator, in coordination with the relevant TSO, according to point (b), and it shall either:

-have the reactive power capabilities for some or all of its equipment in accordance with point (b) already installed as part of the connection of the DC-connected power park module to the AC network at the time of initial connection and commissioning; or

-demonstrate to, and then reach agreement with, the relevant system operator and the relevant TSO on how the reactive power capability will be provided when the DC-connected power park module is connected to more than a single connection point in the AC network, or the AC network at the remote-end HVDC converter station network has either another DC-connected power park module or HVDC system with a different owner connected to it. This agreement shall include a contract by the DC-connected power park module owner (or any subsequent owner), that it will finance and install reactive power

capabilities required by this Article for its power park modules at a point in time specified by the relevant system operator, in coordination with the relevant TSO. The relevant system operator, in coordination with the relevant TSO shall inform the DC-connected power park module owner of the proposed completion date of any committed development which will require the DC-connected power park module owner to install the full reactive power capability.

(ii) the relevant system operator, in coordination with the relevant TSO shall account for the development time schedule of retrofitting the reactive power capability to the DC-connected power park module in specifying the point in time by which this reactive power capability retrofitting is to take place. The development time schedule shall be provided by the DC-connected power park module owner at the time of connection to the AC network.

(b) DC-connected power park modules shall fulfill the following requirements relating to voltage stability either at the time of connection or subsequently, according to the agreement as referred to in point (a):

(i) with regard to reactive power capability at maximum HVDC active power transmission capacity, DC-connected power park modules shall meet the reactive power provision capability requirements specified by the relevant system operator, in coordination with the relevant TSO, in the context of varying voltage. The relevant system operator shall specify a U-Q/Pmax-profile that may take any shape with ranges in accordance with Table 11, Annex VII, within which the DC-connected power park module shall be capable of providing reactive power at its maximum HVDC active power transmission capacity. The relevant system operator, in coordination with the relevant TSO, shall consider the long term development of the network when determining these ranges, as well as the potential costs for power park modules of delivering the capability of providing reactive power production at high voltages and reactive power consumption at low voltages. If the Ten-Year Network Development Plan, where applicable, or a national plan developed and approved in accordance with Article 22 of Directive 2009/72/EC specifies that a DC-connected power park module will become AC-connected to the synchronous area, the relevant TSO may specify that either:

-the DC-connected power park module shall have the capabilities prescribed in Article 25(4) of Regulation (EU) 2016/631 for that synchronous area installed at the time of initial connection and commissioning of the DC-connected power park module to the AC-network; or

-the DC-connected power park module owner shall demonstrate to, and then reach agreement with, the relevant system operator and the relevant TSO on how the reactive power capability prescribed in Article 25(4) of Regulation (EU) 2016/631 for that synchronous area will be provided in the event that the DC-connected power park module becomes AC-connected to the synchronous area.

(ii) With regard to reactive power capability, the relevant system operator may specify supplementary reactive power to be provided if the connection point of a DC-connected power park module is neither located at the high-voltage terminals of the step-up transformer to the voltage level of the connection point nor at the alternator terminals, if no step-up transformer exists. This supplementary reactive power shall compensate the reactive power exchange of the

high-voltage line or cable between the high-voltage terminals of the step-up transformer of the DC-connected power park module or its alternator terminals, if no step-up transformer exists, and the connection point and shall be provided by the responsible owner of that line or cable.

3. With regard to priority to active or reactive power contribution for DC-connected power park modules, the relevant system operator, in coordination with the relevant TSO shall specify whether active power contribution or reactive power contribution has priority during faults for which fault-ride-through capability is required.

4. If priority is given to active power contribution, its provision shall be established within a time from the fault inception as specified by the relevant system operator, in coordination with the relevant TSO.

#### **Article 41**

##### **Control requirements**

1. During the synchronisation of a DC-connected power park module to the AC collection network, the DC-connected power park module shall have the capability to limit any voltage changes to a steady-state level specified by the relevant system operator, in coordination with the relevant TSO. The level specified shall not exceed 5 per cent of the pre-synchronisation voltage. The relevant system operator, in coordination with the relevant TSO, shall specify the maximum magnitude, duration and measurement window of the voltage transients.

2. The DC-connected power park module owner shall provide output signals as specified by the relevant system operator, in coordination with the relevant TSO.

#### **Article 42**

##### **Network characteristics**

With regard to the network characteristics, the following shall apply for the DC-connected power park modules:

- (a) each relevant system operator shall specify and make publicly available the method and the pre-fault and post-fault conditions for the calculation of minimum and maximum short circuit power at the HVDC interface point;
- (b) the DC-connected power park module shall be capable of stable operation within the minimum to maximum range of short circuit power and network characteristics of the HVDC interface point specified by the relevant system operator, in coordination with the relevant TSO;
- (c) each relevant system operator and HVDC system owner shall provide the DC-connected power park module owner with network equivalents representing the system, enabling the DC-connected power park module owners to design their system with regard to harmonics;

## **Article 43**

### **Protection requirements**

1. Electrical protection schemes and settings of DC-connected power park modules shall be determined in accordance with Article 14(5)(b) of Regulation (EU) 2016/631, where the network refers to the synchronous area network. The protection schemes have to be designed taking into account the system performance, grid specificities as well as technical specificities of the power park module technology and agreed with the relevant system operator, in coordination with the relevant TSO.

2. Priority ranking of protection and control of DC-connected power park modules shall be determined in accordance with Article 14(5)(c) of Regulation (EU) 2016/631, where the network refers to the synchronous area network, and agreed with the relevant system operator, in coordination with the relevant TSO.

## **Article 44**

### **Power quality**

1. DC-connected power park modules owners shall ensure that their connection to the network does not result in a level of distortion or fluctuation of the supply voltage on the network, at the connection point, exceeding the level specified by the relevant system operator, in coordination with the relevant TSO. The necessary contribution from grid users to associated studies, including, but not limited to, existing DC-connected power park modules and existing HVDC systems, shall not be unreasonably withheld. The process for necessary studies to be conducted and relevant data to be provided by all grid users involved, as well as mitigating actions identified and implemented, shall be in accordance with the process in Article 29.

## **Article 45**

### **General system management requirements applicable to DC-connected power park modules**

1. With regard to general system management requirements, Articles 14(5), 15(6) and 16(4) of Regulation (EU) 2016/631 shall apply to any DC-connected power park module.

## **CHAPTER 2**

### **Requirements for remote-end HVDC converter stations**

#### **Article 46**

##### **Scope**

1.The requirements of Articles 11 to 39 apply to remote-end HVDC converter stations, subject to specific requirements provided for in Articles 47 to 50.

#### **Article 47**

##### **Frequency stability requirements**

1.Where a nominal frequency other than 50 Hz, or a frequency variable by design is used in the network connecting the DC-connected power park modules, subject to relevant TSO agreement, Article 11 shall apply to the remote-end HVDC converter station with the applicable frequency ranges and time periods specified by the relevant TSO, taking into account specificities of the system and the requirements laid down in Annex I.

2.With regards to frequency response, the remote-end HVDC converter station owner and the DC-connected power park module owner shall agree on the technical modalities of the fast signal communication in accordance with Article 39(1). Where the relevant TSO requires, the HVDC system shall be capable of providing the network frequency at the connection point as a signal. For an HVDC system connecting a power park module the adjustment of active power frequency response shall be limited by the capability of the DC-connected power park modules.

#### **Article 48**

##### **Reactive power and voltage requirements**

1.With respect to voltage ranges:

- (a) a remote-end HVDC converter station shall be capable of staying connected to the remote-end HVDC converter station network and operating within the voltage ranges (per unit) and time periods specified in Tables 12 and 13, Annex VIII. The applicable voltage range and time periods specified are selected based on the reference 1 pu voltage;

- (b) wider voltage ranges or longer minimum times for operation may be agreed between the relevant system operator, in coordination with the relevant TSO, and the DC-connected power park module owner in accordance with Article 40;
- (c) for HVDC interface points at AC voltages that are not included in the scope of Table 12 and Table 13, Annex VIII, the relevant system operator, in coordination with the relevant TSO shall specify applicable requirements at the connection points;
- (d) where frequencies other than nominal 50 Hz are used, subject to agreement by the relevant TSO, the voltage ranges and time periods specified by the relevant system operator, in coordination with the relevant TSO, shall be proportional to those in Annex VIII.

2.A remote-end HVDC converter station shall fulfil the following requirements referring to voltage stability, at the connection points with regard to reactive power capability:

(a) the relevant system operator, in coordination with the relevant TSO shall specify the reactive power provision capability requirements for various voltage levels. In doing so, the relevant system operator, in coordination with the relevant TSO shall specify a U-Q/Pmax-profile of any shape and within the boundaries of which the remote-end HVDC converter station shall be capable of providing reactive power at its maximum HVDC active power transmission capacity

(b) the U-Q/Pmax-profile shall be specified by each relevant system operator, in coordination with the relevant TSO. The U-Q/Pmax-profile shall be within the range of Q/Pmax and steady-state voltage specified in Table 14, Annex VIII, and the position of the U-Q/Pmax-profile envelope shall lie within the limits of the fixed outer envelope specified in Annex IV. The relevant system operator, in coordination with the relevant TSO, shall consider the long term development of the network when determining these ranges.

## **Article 49**

### **Network characteristics**

1. With regard to the network characteristics, the remote-end HVDC converter station owner shall provide relevant data to any DC-connected power park module owner in accordance with Article 42.

## **Article 50**

### **Power quality**

1. Remote-end HVDC converter station owners shall ensure that their connection to the network does not result in a level of distortion or fluctuation of the supply voltage on the network, at the connection point, exceeding the level allocated to them by the relevant system operator, in coordination with the relevant TSO. The necessary contribution from grid users to the associated studies shall not be unreasonably withheld, including from, but not limited to, existing DC-connected power park modules and existing HVDC systems. The process for necessary studies to be conducted and relevant data to be provided by all grid users involved, as well as mitigating actions identified and implemented shall be in accordance with the process provided for in Article 29.



**TITLE IV**  
**INFORMATION EXCHANGE AND COORDINATION**

**Article 51**

**Operation of HVDC systems**

1. With regard to instrumentation for the operation, each HVDC converter unit of an HVDC system shall be equipped with an automatic controller capable of receiving instructions from the relevant system operator and from the relevant TSO. This automatic controller shall be capable of operating the HVDC converter units of the HVDC system in a coordinated way. The relevant system operator shall specify the automatic controller hierarchy per HVDC converter unit.

2. The automatic controller of the HVDC system referred to in paragraph 1 shall be capable of sending the following signal types to the relevant system operator:

(a) operational signals, providing at least the following:

- (i) start-up signals;
- (ii) AC and DC voltage measurements;
- (iii) AC and DC current measurements;
- (iv) active and reactive power measurements on the AC side;
- (v) DC power measurements;
- (vi) HVDC converter unit level operation in a multi-pole type HVDC converter;
- (vii) elements and topology status; and
- (viii) FSM, LFSM-O and LFSM-U active power ranges.

(b) alarm signals, providing at least the following:

- (i) emergency blocking;
- (ii) ramp blocking;
- (iii) fast active power reversal.

3. The automatic controller referred to in paragraph 1 shall be capable of receiving the following signal types from the relevant system operator:

(a) operational signals, receiving at least the following:

- (i) start-up command;
- (ii) active power setpoints;
- (iii) frequency sensitive mode settings;

- (iv) reactive power, voltage or similar setpoints;
- (v) reactive power control modes;
- (vi) power oscillation damping control; and
- (vii) synthetic inertia.

(b) alarm signals, receiving at least the following:

- (i) emergency blocking command;
- (ii) ramp blocking command;
- (iii) active power flow direction; and
- (iv) fast active power reversal command.

4. With regards to each signal, the relevant system operator may specify the quality of the supplied signal.

## **Article 52**

### **Parameters and settings**

1. The parameters and settings of the main control functions of an HVDC system shall be agreed between the HVDC system owner and the relevant system operator, in coordination with the relevant TSO. The parameters and settings shall be implemented within such a control hierarchy that makes their modification possible if necessary. Those main control functions are at least:

- (a) synthetic inertia, if applicable as referred to in Articles 14 and 41;
- (b) frequency sensitive modes (FSM, LFSM-O, LFSM-U) referred to in Articles 15, 16 and 17;
- (c) frequency control, if applicable, referred to in Article 16;
- (d) reactive power control mode, if applicable as referred to in Article 22;
- (e) power oscillation damping capability, referred to Article 30;
- (f) sub-synchronous torsional interaction damping capability, referred to Article 31.

## **Article 53**

### **Fault recording and monitoring**

1. An HVDC system shall be equipped with a facility to provide fault recording and dynamic system behaviour monitoring of the following parameters for each of its HVDC converter stations:

- (a) AC and DC voltage;
- (b) AC and DC current;
- (c) active power;
- (d) reactive power; and
- (e) frequency

2. The relevant system operator may specify quality of supply parameters to be complied with by the HVDC system, provided a reasonable prior notice is given.

3. The particulars of the fault recording equipment referred to in paragraph 1, including analogue and digital channels, the settings, including triggering criteria and the sampling rates, shall be agreed between the HVDC system owner, the relevant system operator and the relevant TSO.

4. All dynamic system behaviour monitoring equipment shall include an oscillation trigger, specified by the relevant system operator, in coordination with the relevant TSO, with the purpose of detecting poorly damped power oscillations.

5. The facilities for quality of supply and dynamic system behaviour monitoring shall include arrangements for the HVDC system owner and the relevant system operator to access the information electronically. The communications protocols for recorded data shall be agreed between the HVDC system owner, the relevant system operator and the relevant TSO.

## **Article 54**

### **Simulation models**

1. The relevant system operator in coordination with the relevant TSO may specify that an HVDC system owner deliver simulation models which properly reflect the behaviour of the HVDC system in both steady-state, dynamic simulations (fundamental frequency component) and in electromagnetic transient simulations. The format in which models shall be provided and the provision of documentation of models structure and block diagrams shall be specified by the relevant system operator in coordination with the relevant TSO.

2. For the purpose of dynamic simulations, the models provided shall contain at least, but not limited to the following sub-models, depending on the existence of the mentioned components:

- a) HVDC converter unit models;
- b) AC component models;
- c) DC grid models;
- d) Voltage and power controller;

e)Special control features if applicable e.g. power oscillation damping (POD) function, subsynchronous torsional interaction (SSTI) control;

f)Multi terminal control, if applicable;

g)HVDC system protection models as agreed between the relevant TSO and the HVDC system owner.

3.The HVDC system owner shall verify the models against the results of compliance tests carried out according to Title VI and a report of this verification shall be submitted to the relevant TSO. The models shall then be used for the purpose of verifying compliance with the requirements of this Regulation including, but not limited to, compliance simulations as provided for in Title VI and used in studies for continuous evaluation in system planning and operation

4.An HVDC system owner shall submit HVDC system recordings to the relevant system operator or relevant TSO if requested in order to compare the response of the models with these recordings.

5.An HVDC system owner shall deliver an equivalent model of the control system when adverse control interactions may result with HVDC converter stations and other connections in close electrical proximity if requested by the relevant system operator or relevant TSO. The equivalent model shall contain all necessary data for the realistic simulation of the adverse control interactions.

## **TITLE V**

### **OPERATIONAL NOTIFICATION PROCEDURE FOR CONNECTION**

#### **CHAPTER 1**

##### **Connection of new HVDC systems**

##### **Article 55**

##### **General provisions**

1.The HVDC system owner shall demonstrate to the relevant system operator that it has complied with the requirements set out in Title II to Title IV at the respective connection point by successfully completing the operational notification procedure for connection of the HVDC system as described in Articles 56 to 59.

2.The relevant system operator shall specify any detailed provisions of the operational notification procedure and make the details publicly available.

3.The operational notification procedure for connection for each new HVDC system shall comprise:

(a)energisation operational notification (EON);

(b)interim operational notification (ION); and

(c)final operational notification (FON).

## **Article 56**

### **EON for HVDC systems**

1.An EON shall entitle the HVDC system owner to energise its internal network and auxiliaries and connect it to the network at its specified connection points.

2.An EON shall be issued by the relevant system operator, subject to completion of preparation and the fulfilment of the requirements specified by the relevant system operator in the relevant operational procedures. This preparation will include agreement on the protection and control settings relevant to the connection points between the relevant system operator and the HVDC system owner.

## **Article 57**

### **ION for HVDC systems**

1.An ION shall entitle a HVDC system owner or HVDC converter unit owner to operate the HVDC system or HVDC converter unit by using the network connections specified for the connection points for a limited period of time.

2.An ION shall be issued by the relevant system operator subject to the completion of the data and study review process.

3.For the purpose of the completion of data and study review, the HVDC system owner or HVDC converter unit owner shall provide the following upon request from the relevant system operator:

(a)itemised statement of compliance;

(b)detailed technical data of the HVDC system with relevance to the network connection, that is specified with respect to the connection points, as specified by the relevant system operator, in coordination with the relevant TSOs;

(c)equipment certificates of HVDC systems or HVDC converter units where these are relied upon as part of the evidence of compliance;

(d)simulation models or a replica of the exact control system as specified by Article 54 and by the relevant system operator in coordination with the relevant TSOs;

(e)studies demonstrating expected steady-state and dynamic performance as required by Titles II, III and IV;

(f)details of intended compliance tests according to Article 72;

(g) details of intended practical method of completing compliance tests pursuant to Title VI.

4. Except where paragraph 5 applies, the maximum period for the HVDC system owner or HVDC converter unit owner to remain in the ION status shall not exceed twenty four months. The relevant system operator may specify a shorter ION validity period. The ION validity period shall be notified to the regulatory authority in accordance with the applicable national regulatory framework. ION extension shall be granted only if the HVDC system owner demonstrates substantial progress towards full compliance. At the time of ION extension, the outstanding issues shall be explicitly identified.

5. The maximum period for an HVDC system owner or HVDC converter unit owner to remain in the ION status may be extended beyond 24 months upon request for a derogation made to the relevant system operator in accordance with the procedure in Title VII. The request shall be made before the expiry of the twenty four month period.

## **Article 58**

### **FON for HVDC systems**

1. A FON shall entitle an HVDC system owner to operate the HVDC system or HVDC converter units by using the grid connection points.

2. A FON shall be issued by the relevant system operator upon prior removal of all incompatibilities identified for the purpose of the ION status and subject to the completion of the data and study review process.

3. For the purpose of the completion of data and study review, the HVDC system owner shall provide the following upon request from the relevant system operator in coordination with the relevant TSO:

(a) itemised statement of compliance; and

(b) update of applicable technical data, simulation models, a replica of the exact control system and studies as referred to in Article 57, including use of actual measured values during testing.

4. In case of incompatibility identified for the purpose of the granting of the FON, a derogation may be granted upon a request to the relevant system operator, in accordance with Articles 79 and 80. A FON shall be issued by the relevant system operator, if the HVDC system is compliant with the provisions of the derogation. Where a request for a derogation is rejected, the relevant system operator shall have the right to refuse the operation of the HVDC system or HVDC converter units, whose owner's request for a derogation was rejected, until the HVDC system owner and the relevant system operator have resolved the incompatibility and the relevant system operator considers that the HVDC system complies with the provisions of this Regulation.

If the relevant system operator and the HVDC system owner do not resolve the incompatibility within a reasonable timeframe, but in any case not later than six months after the notification of the rejection of the request for a derogation, each party may refer the issue for decision to the regulatory authority

## Article 59

### Limited operational notification for HVDC systems/derogations

1. HVDC system owners to whom a FON has been granted shall inform the relevant system operator immediately in the following circumstances:

- (a) the HVDC system is temporarily subject to either a significant modification or loss of capability, due to implementation of one or more modifications of significance to its performance; or
- (b) in case of equipment failures leading to non-compliance with some relevant requirements.

2. The HVDC system owner shall apply to the relevant system operator for a limited operational notification (LON) if the HVDC system owner reasonably expects the circumstances detailed in paragraph 1 to persist for more than three months.

3. A LON shall be issued by the relevant system operator with a clear identification of:

- (a) the unresolved issues justifying the granting of the LON;
- (b) the responsibilities and timescales for expected solution; and
- (c) a maximum period of validity which shall not exceed 12 months. The initial period granted may be shorter with the possibility for extension if evidence to the satisfaction of the relevant system operator demonstrates that substantial progress has been made towards achieving full compliance.

4. The FON shall be suspended during the period of validity of the LON with regard to the subjects for which the LON has been issued.

5. A further prolongation of the period of validity of the LON may be granted upon request for a derogation made to the relevant system operator before the expiry of that period, in accordance with Articles 77 and 78.

6. The relevant system operator may refuse the operation of the HVDC system if the LON terminates and the circumstance which caused it to be issued remains. In such a case the FON shall automatically be invalid.

7. If the relevant system operator does not grant an extension of the period of validity of the LON in accordance with paragraph 5 or if it refuses to allow the operation of the HVDC system once the LON is no longer valid in accordance with paragraph 6, the HVDC system owner may refer the issue for decision to the regulatory authority within six months after the notification of the decision of the relevant system operator.

## **CHAPTER 2**

### **Connection of new DC-connected power park modules**

#### **Article 60**

##### **General provisions**

1. The provisions of this Chapter shall apply to new DC-connected power park modules only.
2. The DC-connected power park module owner shall demonstrate to the relevant system operator its compliance with the requirements referred to in Title III at the respective connection points by successfully completing the operational notification procedure for connection of the DC-connected power park module in accordance with Articles 61 through to 66.
3. The relevant system operator shall specify further details of the operational notification procedure and make those details publically available.
4. The operational notification procedure for connection for each new DC-connected power park module shall comprise:
  - (a) energisation operational notification (EON);
  - (b) interim operational notification (ION); and
  - (c) final operational notification (FON).

#### **Article 61**

##### **EON for DC-connected power park modules**

1. An EON shall entitle the owner of a DC-connected power park module to energise its internal network and auxiliaries by using the grid connection that is specified by the connection points.
2. An EON shall be issued by the relevant system operator, subject to completion of preparation including agreement on the protection and control settings relevant to the connection points between the relevant system operator and the DC-connected power park module.

#### **Article 62**

##### **ION for DC-connected power park modules**

1. An ION shall entitle the DC-connected power park module owner to operate the DC-connected power park module and generate power by using the grid connection for a limited period of time.



2. An ION shall be issued by the relevant system operator, subject to the completion of the data and study review process.

3. With respect to data and study review, the DC-connected power park module owner shall provide the following upon request from the relevant system operator:

(a) itemised statement of compliance;

(b) detailed technical data of the DC-connected power park module with relevance to the grid connection, that is specified by the connection points, as specified by the relevant system operator in coordination with the relevant TSO;

(c) equipment certificates of DC-connected power park module, where these are relied upon as part of the evidence of compliance;

(d) simulation models as specified in Article 54 and as required by the relevant system operator in coordination with the relevant TSO;

(e) studies demonstrating expected steady-state and dynamic performance as required by Title III; and

(f) details of intended compliance tests in accordance with Article 71.

4. Except where paragraph 5 applies, the maximum period for the DC-connected power park module owner to remain in the ION status shall not exceed twenty-four months. The relevant system operator may specify shorter ION validity. The ION validity period shall be notified to the regulatory authority in accordance with the applicable national regulatory framework. ION extensions shall be granted only if the DC-connected power park module owner demonstrates substantial progress towards full compliance. At the time of ION extension, any outstanding issues shall be explicitly identified.

5. The maximum period for a DC-connected power park module owner to remain in the ION status may be extended beyond 24 months upon request for a derogation made to the relevant system operator in accordance with the procedure in Title VII.

## **Article 63**

### **FON for DC-connected power park modules**

1. A FON shall entitle the DC-connected power park module owner to operate the DC-connected power park module by using the grid connection that is specified by the connection point.

2. A FON shall be issued by the relevant system operator, upon prior removal of all incompatibilities identified for the purpose of the ION status and subject to the completion of the data and study review process as required by this Regulation.

3. For the purpose of the completion of data and study review, the DC-connected power park module owner shall provide the following upon request from the relevant system operator:

(a) itemised statement of compliance; and

(b) update of applicable technical data, simulation models and studies as referred to in Article 62(3), including use of actual measured values during testing.

4. In case of incompatibility identified for the purpose of the granting of the FON, a derogation may be granted upon request made to the relevant system operator, in accordance with the derogation procedure according to Title VII. A FON shall be issued by the relevant system operator, if the DC-connected power park module is compliant with the provisions of the derogation. The relevant system operator shall have the right to refuse the operation of the DC-connected power park module, whose owner's request for a derogation was rejected, until the DC-connected power park module owner and the relevant system operator have resolved the incompatibility and the DC-connected power park module is considered to be compliant by the relevant system operator

#### **Article 64**

##### **Limited operational notification for DC-connected power park modules**

1. DC-connected power park module owners to whom a FON has been granted shall inform the relevant system operator immediately in the following circumstances:

(a) the DC-connected power park module is temporarily subject to either a significant modification or loss of capability, due to implementation of one or more modifications of significance to its performance; or

(b) in case of equipment failures leading to non-compliance with some relevant requirements.

2. The DC-connected power park module owner shall apply to the relevant system operator for a limited operational notification (LON), if the DC-connected power park module owner reasonably expects the circumstances detailed in paragraph 1 to persist for more than three months.

3. A LON shall be issued by the relevant TSO with a clear identification of:

(a) the unresolved issues justifying the granting of the LON;

(b) the responsibilities and timescales for expected solution; and

(c) a maximum period of validity which shall not exceed 12 months. The initial period granted may be shorter with the possibility for extension if evidence to the satisfaction of the relevant system operator demonstrating that substantial progress has been made towards achieving full compliance.

4. The FON shall be suspended during the period of validity of the LON with regard to the subjects for which the LON has been issued.

5. A further prolongation of the period of validity of the LON may be granted upon request for a derogation made to the relevant system operator, before the expiry of that period, in accordance with the derogation procedure described in Title VII.

6.The relevant system operator may refuse the operation of the DC-connected power park module if the LON terminates and the circumstance which caused it to be issued remains. In such a case the FON shall automatically be invalid.

## **CHAPTER 3**

### **Cost benefit analysis**

#### **Article 65**

##### **Identification of costs and benefits of application of requirements to existing HVDC systems or DC-connected power park modules**

1.Prior to the application of any requirement set out in this Regulation to existing HVDC systems or DC-connected power park modules in accordance with paragraph 3 of Article 4, the relevant TSO shall undertake a qualitative comparison of costs and benefits related to the requirement under consideration. This comparison shall take into account available network-based or market-based alternatives. The relevant TSO may only proceed to undertake a quantitative cost-benefit analysis in accordance with paragraphs 2 to 5, if the qualitative comparison indicates that the likely benefits exceed the likely costs. If, however, the cost is deemed high or the benefit is deemed low, then the relevant TSO shall not proceed further.

2.Following a preparatory stage undertaken in accordance with paragraph 1, the relevant TSO shall carry out a quantitative cost-benefit analysis of any requirement under consideration for application to existing HVDC systems or DC-connected power park modules that have demonstrated potential benefits as a result of the preparatory stage according to paragraph 1.

3.Within three months of concluding the cost-benefit analysis, the relevant TSO shall summarise the findings in a report which shall:

(a)the cost-benefit analysis and a recommendation on how to proceed;

(b)include a proposal for a transitional period for applying the requirement to existing HVDC systems or DC-connected power park modules. That transitional period shall not be more than two years from the date of the decision of the regulatory authority or where applicable the Contracting Party on the requirement's applicability;

(c)be subject to public consultation in accordance with Article 8.

4.No later than six months after the end of the public consultation, the relevant TSO shall prepare a report explaining the outcome of the consultation and making a proposal on the applicability of the requirement under consideration to existing HVDC systems or DC-connected power park modules. The report and proposal shall be notified to the regulatory authority or, where applicable, the Contracting Party, and the HVDC system owner, DC-connected power park module owner or, where applicable, third party shall be informed on its content.

5.The proposal made by the relevant TSO to the regulatory authority or, where applicable, the Contracting Party pursuant to paragraph 4 shall include the following:

- (a) an operational notification procedure for demonstrating the implementation of the requirements by the owner of the existing HVDC system or DC-connected power park module;
- (b) a transitional period for implementing the requirements which shall take into account the category of HVDC system or DC-connected power park module and any underlying obstacles to the efficient implementation of the equipment modification/refitting.

## **Article 66**

### **Principles of cost-benefit analysis**

1. HVDC system owners, DC-connected power park module owners and DSOs, including CDSOs, shall assist and contribute to the cost-benefit analysis undertaken according to Article 65 and 78 and provide the necessary data as requested by the relevant system operator or relevant TSO within three months of receiving a request, unless agreed otherwise by the relevant TSO. For the preparation of a cost-benefit analysis by a HVDC system owner or DC-connected power park module owner, or their prospective owner, assessing a potential derogation pursuant to Article 77, the relevant TSO and DSO, including CDSO, shall assist and contribute to the cost-benefit analysis and provide the necessary data as requested by the HVDC system owner or DC-connected power park module owner, or their prospective owner, within three months of receiving a request, unless agreed otherwise by the HVDC system owner or DC-connected power park module owner, or their prospective owner.

2. A cost-benefit analysis shall be in line with the following principles:

(a) the relevant TSO, or HVDC system owner or DC-connected power park module owner, or their prospective owner, shall base its cost-benefit analysis on one or more of the following calculating principles:

- (i) the net present value;
- (ii) the return on investment;
- (iii) the rate of return;
- (iv) the time needed to break even.

(b) the relevant TSO, or HVDC system owner or DC-connected power park module owner, or their prospective owner, shall also quantify socioeconomic benefits in terms of improvement in security of supply and shall include at least:

- (i) the associated reduction in probability of loss of supply over the lifetime of the modification;
- (ii) probable extent and duration of such loss of supply;
- (iii) the societal cost per hour of such loss of supply.

(c) the relevant TSO, or HVDC system owner or DC-connected power park module owner, or their prospective owner, shall quantify the benefits to the internal market in electricity, cross-border trade and integration of renewable energies, including at least:

- (i) the active power frequency response;
- (ii) the balancing reserves;
- (iii) the balancing reserves;
- (iv) congestion management;
- (v) defence measures.

(d) the relevant TSO shall quantify the costs of applying the necessary rules to existing HVDC systems or DC-connected power park modules, including at least:

- (i) the direct costs incurred in implementing a requirement;
- (ii) the costs associated with attributable loss of opportunity;
- (iii) the costs associated with resulting changes in maintenance and operation.

## **TITLE VI**

### **COMPLIANCE**

#### **CHAPTER 1**

##### **Compliance monitoring**

#### **Article 67**

##### **Common provisions for compliance testing**

1. Testing of the performance of HVDC systems and DC-connected power park modules shall aim at demonstrating that the requirements of this Regulation have been complied with.

2. Notwithstanding the minimum requirements for compliance testing set out in this Regulation, the relevant system operator is entitled to:

- (a) allow the HVDC system owner or DC-connected power park module owner to carry out an alternative set of tests, provided that those tests are efficient and suffice to demonstrate that a HVDC system or DC-connected power park module complies with the requirements of this Regulation; and

(b) require the HVDC system owner or DC-connected power park module owner to carry out additional or alternative sets of tests in those cases where the information supplied to the relevant system operator in relation to compliance testing under the provisions of Chapter 2,2 and 4 of Title IV, is not sufficient to demonstrate compliance with the requirements of this Regulation.

3. The HVDC system owner or DC-connected power park module owner is responsible for carrying out the tests in accordance with the conditions laid down in Chapter 2,3 and 4 of Title IV. The relevant system operator shall cooperate and not unduly delay the performance of the tests.

4. The relevant system operator may participate in the compliance testing either on site or remotely from the system operator's control centre. For that purpose, the HVDC system owner or DC-connected power park module owner shall provide the monitoring equipment necessary to record all relevant test signals and measurements as well as ensure that the necessary representatives of the HVDC system owner or DC-connected power park module owner available on site for the entire testing period. Signals specified by the relevant system operator shall be provided if, for selected tests, the system operator wishes to use its own equipment to record performance. The relevant system operator has sole discretion to decide about its participation.

## **Article 68**

### **Common provisions on compliance simulation**

1. Simulation of the performance of HVDC systems and DC-connected power park modules shall aim at demonstrating that the requirements of this Regulation have been fulfilled.

2. Notwithstanding the minimum requirements set out in this Regulation for compliance simulation, the relevant system operator may:

a) allow the HVDC system owner or DC-connected power park module owner to carry out an alternative set of simulations, provided that those simulations are efficient and suffice to demonstrate that a HVDC system or DC-connected power park module complies with the requirements of this Regulation or with national legislation; and

b) require the HVDC system owner or DC-connected power park module owner to carry out additional or alternative sets of simulations in those cases where the information supplied to the relevant system operator in relation to compliance simulation under the provisions of Chapter 5,6 or 7 of Title IV, is not sufficient to demonstrate compliance with the requirements of this Regulation.

3.To demonstrate compliance with the requirements of this Regulation, the HVDC system owner and DC-connected power park module owner shall provide a report with the simulation results. The HVDC system owner and DC-connected power park module owner shall produce and provide a validated simulation model for a given HVDC system or DC-connected power park module. The scope of the simulation models is set out in point (c) of Article 15(6).

4.The relevant system operator shall have the right to check that a HVDC system and DC-connected power park module complies with the requirements of this Regulation by carrying out its own compliance simulations based on the provided simulation reports, simulation models and compliance test measurements.

5.The relevant system operator shall provide the HVDC system owner or DC-connected power park module owner with technical data and a simulation model of the network, to the extent necessary to carry out the requested simulations in accordance with Chapter 5,6 or 7 of Title IV.

## **Article 69**

### **Responsibility of the HVDC system owner and DC-connected power park module owner**

1.The HVDC system owner shall ensure that the HVDC system and HVDC converter stations are compliant with the requirements provided for by this Regulation. This compliance shall be maintained throughout the lifetime of the facility.

2.The DC-connected power park module owner shall ensure that the DC-connected power park module is compliant with the requirements under this Regulation. This compliance shall be maintained throughout the lifetime of the facility.

3.Planned modifications of the technical capabilities of the HVDC system, HVDC converter station or DC-connected power park module with possible impact on its compliance to the requirements under this Regulation shall be notified to the relevant system operator by the HVDC system owner or DC-connected power park module owner before initiating such modification.

4.Any operational incidents or failures of an HVDC system, HVDC converter station or DC-connected power park module that have impact on its compliance to the requirements of this Regulation shall be notified to the relevant system operator by the HVDC system owner or DC-connected power park module owner as soon as possible without any delay after the occurrence of such an incident.

5.Any foreseen test schedules and procedures to verify compliance of an HVDC system, HVDC converter station or DC-connected power park module with the requirements of this Regulation shall be notified to the relevant system operator by the HVDC system owner or DC-connected power park module owner in due time and prior to their launch and shall be approved by the relevant system operator.

6.The relevant system operator shall be facilitated to participate in such tests and may record the performance of the HVDC systems, HVDC converter stations or DC-connected power park modules.

## **Article 70**

### **Tasks of the relevant system operator**

1. The relevant system operator shall assess the compliance of an HVDC system, HVDC converter station and DC-connected power park module with the requirements under this Regulation throughout the lifetime of the HVDC system, HVDC converter station or DC-connected power park module. The HVDC system owner or DC-connected power park module owner shall be informed of the outcome of this assessment.

2. Where requested by the relevant system operator, the HVDC system owner or DC-connected power park module owner shall carry out compliance tests and simulations, not only during the operational notification procedures according to Title V, but repeatedly throughout the lifetime of the HVDC system, HVDC converter station or DC-connected power park module according to a plan or general scheme for repeated tests and specified simulations or after any failure, modification or replacement of any equipment that may have impact on the compliance with the requirements under this Regulation. The HVDC system owner or DC-connected power park module owner shall be informed of the outcome of these compliance tests and simulations.

3. The relevant system operator shall make publicly available the list of information and documents to be provided as well as the requirements to be fulfilled by the HVDC system owner or DC-connected power park module owner in the frame of the compliance process.

Such list shall cover at least the following information, documents and requirements:

- a) all documentation and certificates to be provided by the HVDC system owner or DC-connected power park module owner;
- b) details of the technical data of the HVDC system, HVDC converter station or DC-connected power park module with relevance to the grid connection;
- c) requirements for models for steady-state and dynamic system studies;
- d) timeline for the provision of system data required to perform the studies;
- e) studies by the HVDC system owner or DC-connected power park module owner to demonstrate the expected steady-state and dynamic performance in accordance with the requirements set out in Titles II, III and IV;
- f) conditions and procedures including the scope for registering equipment certificates; and
- g) conditions and procedures for use of relevant equipment certificates, issued by an authorised certifier, by the DC-connected power park module owner.

4. The relevant system operator shall make publicly available the allocation of responsibilities to the HVDC system owner or DC-connected power park module owner and to the system operator for compliance testing, simulation and monitoring.



5.The relevant system operator may partially or totally assign the performance of its compliance monitoring to third parties. In this case, the relevant system operator shall ensure compliance with Article 10 by appropriate confidentiality commitments with the assignee.

6.The relevant system operator shall not unreasonably withhold any operational notification in accordance with Title V, if compliance tests or simulations cannot be performed as agreed between the relevant system operator and the HVDC system owner or DC-connected power park module owner due to reasons which are in the sole control of the relevant system operator.

7.The relevant system operator shall provide the relevant TSO when requested the compliance test and simulation results referred to in this Chapter.

## **CHAPTER 2**

### **Compliance testing**

#### **Article 71**

##### **Compliance testing for HVDC systems**

1.Equipment certificates may be used instead of part of the tests below, on the condition that they are provided to the relevant system operator.

2.With regard to the reactive power capability test:

a) the HVDC converter unit or the HVDC converter station shall demonstrate its technical capability to provide leading and lagging reactive power capability according to Article 20;

b) the reactive power capability test shall be carried out at maximum reactive power, both leading and lagging, and concerning the verification of the following parameters:

(i)Operation at minimum HVDC active power transmission capacity;

(ii)Operation at maximum HVDC active power transmission capacity;

(iii)Operation at active power setpoint between those minimum and maximum HVDC active power transmission capacity.

c) the test shall be deemed passed, provided that the following conditions are cumulatively fulfilled:

i. the HVDC converter unit or the HVDC converter station has been operating no shorter than 1 hour at maximum reactive power, both leading and lagging, for each parameter as referred to in point (b);

ii. the HVDC converter unit or the HVDC converter station demonstrates its capability to change to any reactive power setpoint within the applicable reactive power range within the specified performance targets of the relevant reactive power control scheme; and

iii.no action of any protection within the operation limits specified by reactive power capacity diagram occurs.

3. With regard to the voltage control mode test:

a) the HVDC converter unit or the HVDC converter station shall demonstrate its capability to operate in voltage control mode in the conditions set forth in Article 22(3);

b) the voltage control mode test shall apply concerning the verification of the following parameters:

(i) the implemented slope and deadband of the static characteristic;

(ii) the accuracy of the regulation;

(iii) the insensitivity of the regulation;

(iv) the time of reactive power activation

c) the test shall be deemed passed, provided that the following conditions are cumulatively fulfilled:

(i) the range of regulation and adjustable droop and deadband is compliant with agreed or decided characteristic parameters, according to Article 22(3);

(ii) the insensitivity of voltage control is not higher than 0,01 pu ; according to Article 22(3);

(iii) following a step change in voltage, 90 % of the change in reactive power output has been achieved within the times and tolerances according to Article 22(3).

4. With regard to the reactive power control mode test:

a) the HVDC converter unit or the HVDC converter station shall demonstrate its capability to operate in reactive power control mode, according to the conditions referred to in Article 22(4);

b) the reactive power control mode test shall be complementary to the reactive power capability test

c) the reactive power control mode test shall apply concerning the verification of the following parameters:

(i) the reactive power setpoint range and step;

(ii) the accuracy of the regulation; and

(iii) the time of reactive power activation.

d) the test shall be deemed passed, provided that the following conditions are cumulatively fulfilled:

(i) the reactive power setpoint range and step is ensured according to Article 22(4);

(ii) the accuracy of the regulation is compliant with the conditions as referred to in Article 22(3).

5. With regard to the power factor control mode test:

a) the HVDC converter unit or the HVDC converter station shall demonstrate its capability to operate in power factor control mode according to the conditions referred to in Article 22(5);

b) the power factor control mode test shall apply concerning the verification of the following parameters:

i. the power factor setpoint range

ii. the accuracy of the regulation;

iii. the response of reactive power due to step change of active power.

c) the test shall be deemed passed, provided that the following conditions are cumulatively fulfilled:

(i) the power factor setpoint range and step is ensured according to Article 22(5);

(ii) the time of reactive power activation as result of step active power change does not exceed the requirements specified in accordance with Article 22(5);

(iii) the accuracy of the regulation is compliant with the value, as referred to in Article 22(5).

6. With regard to the FSM response test:

a) the HVDC system shall demonstrate its technical capability to continuously modulate active power over the full operating range between maximum HVDC active power transmission capacity and minimum HVDC active power transmission capacity to contribute to frequency control and shall verify the steady-state parameters of regulations, such as droop and deadband and dynamic parameters, including robustness during frequency step change response and large, fast frequency changes;

b) the test shall be carried out by simulating frequency steps and ramps big enough to activate at least 10 % of the full active power frequency response range in each direction, taking into account the droop settings and the deadband. Simulated frequency deviation signals shall be injected into the controller of the HVDC converter unit or the HVDC converter station;

c) the test shall be deemed to be passed, provided that the following conditions are all fulfilled:

(i) activation time of full active power frequency response range as result of a step frequency change has been no longer than required by Annex II;

(ii) undamped oscillations do not occur after the step change response;

(iii) the initial delay time has been according to Annex II;

(iv) the droop settings are available within the range provided for in Annex II and deadband (thresholds) is not more than the value in Annex II;

(v) insensitivity of active power frequency response at any relevant operating point does not exceed the requirements set forth in Annex II.

7. With regard to the LFSM-O response test:

a) the HVDC system shall demonstrate its technical capability to continuously modulate active power to contribute to frequency control in case of large increase of frequency in the system and shall verify the steady-state parameters of regulations, such as droop and deadband, and dynamic parameters, including frequency step change response;

b) the test shall be carried out by simulating frequency steps and ramps big enough to activate at least 10% of the full operating range for active power, taking into account the droop settings and the deadband.

Simulated frequency deviation signals shall be injected into the controller of the HVDC converter unit or the HVDC converter station;

c) the test shall be deemed passed, provided that the following conditions are both fulfilled:

(i) the test results, for both dynamic and static parameters, are in line with the requirements as referred to in Annex II;

(ii) undamped oscillations do not occur after the step change response.

8. With regard to the LFSM-U response test:

a) the HVDC system shall demonstrate its technical capability to continuously modulate active power at operating points below maximum HVDC active power transmission capacity to contribute to frequency control in case of large drop of frequency in the system;

b) the test shall be carried out by simulating at appropriate active power load points with low frequency steps and ramps big enough to activate at least 10 % of the full operating range for active power, taking into account the droop settings and the deadband. Simulated frequency deviation signals shall be injected into the controller of the HVDC converter unit or the HVDC converter station;

c) the test shall be deemed passed, provided that the following conditions are both fulfilled:

(i) the test results, for both dynamic and static parameters, are in line with the requirements as referred to in Annex II;

(ii) undamped oscillations do not occur after the step change response.

9. With regard to the active power controllability test:

a) the HVDC system shall demonstrate its technical capability to continuously modulate active power over the full operating range according to Article 13(1)(a) and (d);

b) the test shall be carried out by sending manual and automatic instructions by the relevant TSO;

c) the test shall be deemed passed, provided that the following conditions are cumulatively fulfilled:

(i) the HVDC system has demonstrated stable operation;

(ii) the time of adjustment of the active power is shorter than the delay specified pursuant to Article 13(1)(a);

(iii) the dynamic response of the HVDC system when receiving instructions for the purposes of exchange or sharing of reserves, or for participating in imbalance netting processes, if capable of fulfilling the requirements for these products, as specified by the relevant TSO, has been demonstrated.

10. With regard to the ramping rate modification test:

a) the HVDC system shall demonstrate its technical capability to adjust the ramping rate according to Article 13(2);

b) the test shall be carried out by relevant TSO sending instructions of ramping modifications;

c) the test shall be deemed passed, provided that the following conditions are cumulatively fulfilled:

(i)ramping rate is adjustable;

(ii)the HVDC system has demonstrated stable operation during ramping periods.

11.With regard to the black start test, if applicable:

a) the HVDC system shall demonstrate its technical capability to energise the busbar of the remote AC substation to which it is connected, within a time frame specified by the relevant TSO, according to Article 37(2);

b) the test shall be carried out while the HVDC system starts from shut down;

c) the test shall be deemed passed, provided that the following conditions are cumulatively fulfilled:

(i)the HVDC system has demonstrated being able to energise the busbar of the remote AC-substation to which it is connected;

(ii)the HVDC system operates from a stable operating point at agreed capacity, according to the procedure of Article 37(3).

## **Article 72**

### **Compliance testing for DC-connected power park modules and remote-end HVDC converter units**

1.Equipment certificates may be used instead of part of the tests below, on the condition that they are provided to the relevant system operator.

2.With regard to the reactive power capability test of DC-connected power park modules:

a) the DC-connected power park module shall demonstrate its technical capability to provide leading and lagging reactive power capability according to Article 40(2);

b) the reactive power capability test shall be carried out at maximum reactive power, both leading and lagging, and concerning the verification of the following parameters:

(i)operation in excess of 60 % of maximum capacity for 30 minutes;

(ii)operation within the range of 30-50 % of maximum capacity for 30 minutes; and

(iii)operation within the range of 10-20 % of maximum capacity for 60 minutes.

c) the test shall be deemed passed, provided that the following conditions are cumulatively fulfilled:

(i)the DC-connected power park module has been operating no shorter than requested duration at maximum reactive power, both leading and lagging, in each parameter as referred to in point

(b);

(ii)the DC-connected power park module has demonstrated its capability to change to any reactive power setpoint within the agreed or decided reactive power range within the specified performance targets of the relevant reactive power control scheme; and

(iii)no action of any protection within the operation limits specified by reactive power capacity diagram occurs.

3.With regard to the reactive power capability test of remote-end HVDC converter units:

a) the HVDC converter unit or the HVDC converter station shall demonstrate its technical capability to provide leading and lagging reactive power capability according to Article 48(2);

b) the test shall be deemed passed, provided that the following conditions are cumulatively fulfilled:

(i)the HVDC converter unit or the HVDC converter station has been operating no shorter than 1 hour at maximum reactive power, both leading and lagging, at:

- minimum HVDC active power transmission capacity;
- maximum HVDC active power transmission capacity; and
- an active power operating point between those maximum and minimum ranges.

(ii)the HVDC converter unit or the HVDC converter station demonstrates its capability to change to any reactive power setpoint within the agreed or decided reactive power range within the specified performance targets of the relevant reactive power control scheme; and

(iii)no action of any protection within the operation limits specified by reactive power capacity diagram occurs.

4.With regard to the voltage control mode test:

a) the DC-connected power park module shall demonstrate its capability to operate in voltage control mode in the conditions set forth in Article 21 of Regulation (EU) 2016/631;

b) the voltage control mode test shall apply concerning the verification of the following parameters:

(i)the implemented slope and deadband of the static characteristic;

(ii)the accuracy of the regulation;

(iii)the insensitivity of the regulation;

(iv)the time of reactive power activation.

c) the test shall be deemed passed, provided that the following conditions are cumulatively fulfilled:

(i)the range of regulation and adjustable the droop and deadband is compliant with agreed or decided characteristic parameters, according to Article 21(3)(d) of Regulation (EU) 2016/631;

(ii)the insensitivity of voltage control is not higher than 0,01 pu, according to Article 21(3) of Regulation (EU) 2016/631;

(iii) following a step change in voltage, 90 % of the change in reactive power output has been achieved within the times and tolerances according to Article 21(3)(d) of Regulation (EU) 2016/631.

5. With regard to the reactive power control mode test:

a) the DC-connected power park module shall demonstrate its capability to operate in reactive power control mode, according to the conditions referred to in Article 21(3)(d)(iii) of Regulation (EU) 2016/631;

b) the reactive power control mode test shall be complementary to the reactive power capability test

c) the reactive power control mode test shall apply concerning the verification of the following parameters:

(i) the reactive power setpoint range and step;

(ii) the accuracy of the regulation;

(iii) the time of reactive power activation.

d) the test shall be deemed passed, provided that the following conditions are cumulatively fulfilled:

(i) the reactive power setpoint range and step is ensured according to Article 21(3)(d) of Regulation (EU) 2016/631;

(ii) the accuracy of the regulation is compliant with the conditions as referred to in Article 21(3)(d) of Regulation (EU) 2016/631.

6. With regard to the power factor control mode test:

(a) the DC-connected power park module shall demonstrate its capability to operate in power factor control mode according to the conditions referred to in Article 21(3)(d)(iv) of Regulation (EU) 2016/631;

(b) the power factor control mode test shall apply concerning the verification of the following parameters:

(i) the power factor setpoint range;

(ii) the accuracy of the regulation;

(iii) the response of reactive power due to step change of active power.

c) the test shall be deemed passed, provided that the following conditions are cumulatively fulfilled:

(i) the power factor setpoint range and step is ensured according to Article 21(3)(d) of Regulation (EU) 2016/631;

(ii) the time of reactive power activation as result of step active power change does not exceed the requirement according to Article 21(3)(d) of Regulation (EU) 2016/631;

(iii) the accuracy of the regulation is compliant with the value, as referred to in Article 21(3)(d) of Regulation (EU) 2016/631.

7. With regard to the tests identified in paragraphs 4, 5 and 6 the relevant TSO may select only two of the three control options for testing.

8. With regard to LFSM-O response of DC-connected power park module, the tests shall be carried out in accordance with Article 46(2) of Regulation (EU) 2016/631.

9. With regard to LFSM-U response of DC-connected power park module, the tests shall be carried out in accordance with Article 47(3) of Regulation (EU) 2016/631.

10. With regard to active power controllability of DC-connected power park module, the tests shall be carried out in accordance with 47(2) of Regulation (EU) 2016/631.

11. With regard to FSM response of DC-connected power park module, the tests shall be carried out in accordance with Article 47(4) of Regulation (EU) 2016/631.

12. With regard to frequency restoration control of DC-connected power park module, the tests shall be carried out in accordance with Article 47(5) of Regulation (EU) 2016/631.

13. With regard to fast signal response of DC-connected power park module, the test shall be deemed passed if the DC-connected power park module can demonstrate its response within the time specified in Article 39(1)(a).

14. With regard to tests for DC-connected power park modules where the AC collection network is not at nominal 50 Hz frequency, the relevant system operator, in coordination with the relevant TSO, shall agree with the DC-connected power park module owner the compliance tests required.

## **CHAPTER 3**

### **Compliance simulations**

#### **Article 73**

#### **Compliance simulations for HVDC systems**

1. Equipment certificates may be used instead of part of the simulations below, on the condition that they are provided to the relevant system operator.

2. With regard to the fast fault current injection simulation:

a) the HVDC converter unit owner or the HVDC converter station owner shall simulate fast fault current injection in the conditions set forth in Article 19;

b) the simulation is deemed passed, provided that compliance with the requirements specified in accordance with Article 19 is demonstrated.

3. With regard to the fault-ride-through capability simulation:

a) the HVDC system owner shall simulate the capability for fault-ride-through in the conditions set forth in Article 25; and



b) the simulation is deemed passed, provided that compliance with the requirements specified in accordance with Article 25 is demonstrated.

4. With regard to the post fault active power recovery simulation:

a) the HVDC system owner shall simulate the capability for post fault active power recovery in the conditions set forth in Article 26;

b) the simulation is deemed passed, provided that compliance with the requirements specified in accordance with Article 26 is demonstrated.

5. With regard to the reactive power capability simulation:

a) the HVDC converter unit owner or the HVDC converter station owner shall simulate the capability for leading and lagging reactive power capability in the conditions referred to in Article 20(2) to (4);

b) the simulation shall be deemed passed, provided that the following conditions are cumulatively fulfilled

(i) the simulation model of the HVDC converter unit or the HVDC converter station is validated against the compliance tests for reactive power capability as referred to in Article 69;

(ii) compliance with the requirements as referred to in Article 20(2) to (4) is demonstrated

6. With regard to the power oscillations damping control simulation:

a) the HVDC system owner shall demonstrate the performance of its control system (POD function) to damp power oscillations in the conditions set forth in Article 30;

b) the tuning shall result in improved damping of corresponding active power response of the HVDC system in combination with the POD function compared to the active power response of the HVDC system without POD;

c) the simulation shall be deemed passed, provided that the following conditions are cumulatively fulfilled:

(i) the POD function damps the existing power oscillations of the HVDC system within a frequency range specified by the relevant TSO. This frequency range shall include the local mode frequency of the HVDC system and the expected network oscillations; and

(ii) a change of active power transfer of the HVDC system as specified by the relevant TSO does not lead to undamped oscillations in active or reactive power of the HVDC system.

7. With regard to the simulation of active power modification in case of disturbance:

a) the HVDC system owner shall simulate the capability to quickly modify active power according to Article 13(1)(b); and

b) the simulation shall be deemed passed, provided that the following conditions are cumulatively fulfilled

(i) the HVDC system has demonstrated stable operation when following the pre-specified sequence of active power variation;

(ii) the initial delay of the adjustment of the active power is shorter than the value specified in Article 13(1)(b) or reasonably justified if greater.

8. With regard to the fast active power reversal simulation, as applicable:

a) the HVDC system owner shall simulate the capability to quickly reverse active power according to Article 13(1)(c);

b) the simulation shall be deemed passed, provided that the following conditions are cumulatively fulfilled:

(i) the HVDC system has demonstrated stable operation;

(ii) the time of adjustment of the active power is shorter than the value specified in Article 13(1)(c) or reasonably justified if greater.

## **Article 74**

### **Compliance simulations for DC-connected power park modules and remote-end HVDC converter units**

1. DC-connected power park modules are subject to the compliance simulations detailed in this Article. Equipment certificates may be used instead of part of the simulations described below, on the condition that they are provided to the relevant system operator.

2. With regard to the fast fault current injection simulation:

a) the DC-connected power park module owner shall simulate the capability for fast fault current injection in the conditions set forth in Article 20(2)(b) of Regulation (EU) 2016/631; and

b) the simulation shall be deemed passed, provided that compliance with the requirement according to Article 20(2)(b) of Regulation (EU) 2016/631 is demonstrated.

3. With regard to the post fault active power recovery simulation:

a) the DC-connected power park module owner shall simulate the capability for post fault active power recovery in the conditions set forth in Article 20(3)(a) of Regulation (EU) 2016/631; and

b) the simulation shall be deemed passed, provided that compliance with the requirement according to Article 20(3)(a) of Regulation (EU) 2016/631 is demonstrated.

4. With regard to the reactive power capability simulation of DC-connected power park modules:

a) the DC-connected power park module owner shall simulate the capability for leading and lagging reactive power capability in the conditions referred to in Article 40(2); and

b) the simulation shall be deemed passed, provided that the following conditions are cumulatively fulfilled

- (i) the simulation model of the DC-connected power park module is validated against the compliance tests for reactive power capability as referred to in Article 70(2);
- (ii) compliance with the requirements as referred to in Article 40(2) is demonstrated.

5. With regard to the reactive power capability simulation of remote-end HVDC converter units:

a) the remote-end HVDC converter unit owner or the remote-end HVDC converter station owner shall simulate the capability for leading and lagging reactive power capability in the conditions referred to in Article 48(2); and

b) the simulation shall be deemed passed, provided that the following conditions are cumulatively fulfilled

- (i) the simulation model of the remote-end HVDC converter unit or the remote-end HVDC converter station is validated against the compliance tests for reactive power capability at the as referred to in Article 70(3);

- (ii) compliance with the requirements as referred to in Article 48(2) is demonstrated

6. With regard to the power oscillations damping control simulation:

a) the DC-connected power park module owner shall simulate the capability for power oscillations damping under the conditions as referred to in Article 21(3)(f) of Regulation (EU) 2016/631; and

b) the simulation shall be deemed passed, provided that the model demonstrates compliance with the conditions of Article 21(3)(f) of Regulation (EU) 2016/631.

7. With regard to fault-ride-through capability simulation:

a) DC-connected power park module owner shall simulate the capability for fault-ride-through under the conditions as referred to in Article 16(3)(a) of Regulation (EU) 2016/631;

b) the simulation shall be deemed passed, provided that the model demonstrates compliance with the conditions of Article 16(3)(a) of Regulation (EU) 2016/631.

## **CHAPTER 4**

### **Non-binding guidance and monitoring of implementation**

#### **Article 75**

##### **Non-binding guidance on implementation**

1. No later than six months after the entry into force of this Regulation, the European Network of Transmission System Operators for Electricity shall prepare and thereafter every two years provide non-binding written guidance to its members and other system operators regarding with the elements of this Regulation that require national decisions. ENTSO -E shall publish this guide on its website.<sup>3</sup>

2.ENTSO-E shall consult with interested parties when issuing non-binding guidance<sup>4</sup>

3.The non-binding guidance published by ENTSO for Electricity explains the technical issues, conditions and interdependencies which need to be considered when complying with the requirements of this Regulation at national level.

## **Article 76**

### **Monitoring**

1.ENTSO for Electricity shall monitor the implementation of this Regulation identification of any for the Contracting Parties whose TSOs are members of ENTSO for divergences in the national Electricity. The Secretariat and the Energy Community Regulatory Board shall monitor the implementation of this Regulation for the Contracting Parties whose TSOs are not members of ENTSO for Electricity. Monitoring shall take into account the list of relevant information developed by the Agency for the Cooperation of Energy Regulators and it shall cover in particular the following matters<sup>5</sup>

- a) identification of any divergence in the national implementation of this Regulation
- b) assessment of whether the choice of values and ranges in the requirements applicable to HVDC systems and DC-connected power park modules under this Regulation continues to be valid.

ENTSO for Electricity shall report its findings to the Secretariat and the Energy Community Regulatory Board the Secretariat and the Energy Community Regulatory Board shall make available the findings stemming from the monitoring of the implementation of this Regulation.

2.The Energy Community Regulatory Board, in cooperation with ENTSO-E, must present in 12 months after the entry into force of this Regulation a list of relevant information to be communicated by ENTSO-E in accordance with Article 8 (9) and Article 9 (1) of Regulation (EC) No. 714/2009. The list of relevant information may be subject to updates. The ENTSO for Electricity shall maintain a complete, standardized format, digital data archive of the information required by the Energy Community Regulatory Board<sup>6</sup>

<sup>3</sup>Article 75 paragraph (1) shall be not applied based on decision 2018/04/PHLG-EnC

<sup>4</sup>Article 75 paragraph (2) shall be not applied based on decision 2018/04/PHLG-EnC

<sup>5</sup>Based on article (8) of Regulation (EC) No 714/2009 – the text shall be not applied based on decision 2018/04/PHLG-EnC

3.Relevant TSOs shall submit to the Secretariat, the Energy Community Regulatory Board and ENTSO for Electricity the information required to perform the tasks referred to in paragraph 1 and 2.<sup>7</sup>

Based on a request of the regulatory authority, OSHEE company shall provide TSOs with information under paragraph 1 unless the information is already obtained by regulatory authorities, the Secretariat, Energy Community Regulatory Board or ENTSO-E in relation to their respective implementation monitoring tasks, with the objective of avoiding duplication of information.

4.When ENTSO-E or the Energy Community Regulatory Board create areas subject to this Regulation, when, based on market developments or the experience gathered in the implementation of this Regulation, it is advisable to further harmonize the requirements under this Regulation to promoting market integration, they propose draft amendments to this Regulation in accordance with Article 7 (1) of Regulation (EC) No. 714/2009.<sup>8</sup>

## **TITLE VII**

### **DEROGATIONS**

#### **Article 77**

##### **Power to grant derogations**

1.Regulatory authorities may, at the request of a HVDC system owner or DC-connected power park module owner, or their prospective owner, relevant system operator or relevant TSO, grant HVDC system owners or DC-connected power park module owners, or their prospective owner, relevant system operators or relevant TSOs derogations from one or more provisions of this Regulation for new and existing HVDC system and/or DC-connected power park modules in accordance with Articles 76 to 80.

2.Where applicable in a Contracting Party, derogations may be granted and revoked in accordance with Articles 76 to 79 by other authorities than the regulatory authority.

#### **Article 78**

##### **General provisions**

1)Each regulatory authority shall specify, after consulting relevant system operators, HVDC system owners and DC-connected power park module owners and other stakeholders whom it deems affected by this Regulation, the criteria for granting derogations pursuant to Articles 79 to 81. It shall publish those criteria on its website and notify them to the Secretariat within nine months of the expiry of the deadline for transposition of this Regulation. The Secretariat may require a regulatory authority to amend the criteria if it considers that they are not in line with this Regulation. This possibility to review and amend the criteria for granting derogations shall not affect the derogations already granted which shall continue to apply until the scheduled expiry date as detailed in the decision granting the exemption.

2) If the regulatory authority deems that it is necessary due to a change in circumstances relating to the evolution of system requirements, it may review and amend at most once every year the criteria for granting derogations in accordance with paragraph 1. Any changes to the criteria shall not apply to derogations for which a request has already been made.

3) The regulatory authority may decide that HVDC systems or DC-connected power park modules for which a request for a derogation has been filed pursuant to Articles 79 to 81 do not need to comply with the requirements of this Regulation from which a derogation has been sought from the day of filing the request until the regulatory authority's decision is issued.

## **Article 79**

### **Request for derogations by an HVDC system owner or DC-connected power park module owner**

1. HVDC system owners and DC-connected power park module owners, or their prospective owner, may request a derogation to one or several requirements of this Regulation.

2. A request for a derogation shall be filed with the relevant system operator and include:

- a) an identification of the HVDC system owner or DC-connected power park module owner, or their prospective owner, and a contact person for any communications;
- b) a description of the HVDC system or DC-connected power park module for which a derogation is requested
- c) a reference to the provisions of this Regulation from which a derogation is requested and a detailed description of the requested derogation;
- d) detailed reasoning, with relevant supporting documents, and cost-benefit analysis pursuant to the requirements of Article 66;
- e) demonstration that the requested derogation would have no adverse effect on cross-border trade
- f) in the case of a DC-connected power park module connected to one or more remote-end HVDC converter stations, evidence that the converter station will not be affected by the derogation or, alternatively, agreement from the converter station owner to the proposed derogation.

<sup>6</sup>Article 76 paragraph (2) shall be not applied based on decision 2018/04/PHLG-EnC

<sup>7</sup>paragraph 2 – the text shall be not applied based on decision 2018/04/PHLG-EnC

<sup>8</sup>Article 76 paragraph (4) shall be not applied based on decision 2018/04/PHLG-EnC

3. Within two weeks of receipt of a request for a derogation, the relevant system operator shall confirm to the HVDC system owner or DC-connected power park module owner, or their prospective owner, whether the request is complete. If the relevant system operator considers that the request is incomplete, the HVDC system owner or DC-connected power park module owner, or their prospective owner, shall submit the additional required information within one month from the receipt of the request for additional information. If the HVDC system owner or DC-connected power park module owner, or their prospective owner, does not supply the requested information within that time limit, the request for a derogation shall be deemed withdrawn.

4. The relevant system operator shall, in coordination with the relevant TSO and any affected adjacent DSO or DSOs, assess the request for a derogation and the provided cost-benefit analysis, taking into account the criteria determined by the regulatory authority pursuant to Article 78.

5. If a request for a derogation concerns a HVDC system or DC-connected power park module connected to a distribution system, including a closed distribution system, the relevant system operator's assessment must be accompanied by an assessment of the request for a derogation by the relevant TSO. The relevant TSO shall provide its assessment within two months of being requested to do so by the relevant system operator.

6. Within six months of receipt of a request for a derogation, the relevant system operator shall forward the request to the regulatory authority and submit the assessment(s) prepared in accordance with paragraphs 4 and 5. That period may be extended by one month where the relevant system operator seeks further information from the HVDC system owner or DC-connected power park module owner, or their prospective owner, and by two months where the relevant system operator requests the relevant TSO to submit an assessment of the request for a derogation.

7. The regulatory authority shall adopt a decision concerning any request for a derogation within six months from the day after it receives the request. That time limit may be extended by three months before its expiry where the regulatory authority requires further information from the HVDC system owner or DC-connected power park module owner, or their prospective owner, or from any other interested parties. The additional period shall begin when the complete information has been received.

8. The HVDC system owner or DC-connected power park module owner, or their prospective owner, shall submit any additional information requested by the regulatory authority within two months of such request. If the HVDC system owner or DC-connected power park module owner, or the prospective owner, does not supply the requested information within that time limit, the request for a derogation shall be deemed withdrawn unless, before its expiry

a. the regulatory authority decides to provide an extension; or

b. the HVDC system owner or DC-connected power park module owner, or their prospective owner, informs the regulatory authority by means of a reasoned submission that the request for a derogation is complete.

9. The regulatory authority shall issue a reasoned decision concerning a request for a derogation. Where the regulatory authority grants a derogation, it shall specify its duration.

10. The regulatory authority shall notify its decision to the HVDC system owner or DC-connected power park module owner, or their prospective owner, the relevant system operator and the relevant TSO.

11. A regulatory authority may revoke a decision granting a derogation if the circumstances and underlying reasons no longer apply or upon a reasoned recommendation of the Secretariat or reasoned recommendation by the Energy Community Regulatory Board pursuant to Article 83(2).

## **Article 80**

### **Request for a derogation by a relevant system operator or relevant TSO**

1. Relevant system operators or relevant TSOs may request a derogation for classes of HVDC systems or DC-connected power park modules connected or to be connected to their network.

2. Relevant system operators or relevant TSOs shall submit their requests for a derogation to the regulatory authority. Each request for a derogation shall include:

a) identification of the relevant system operator or relevant TSO, and a contact person for any communications;

b) a description of the HVDC systems or DC-connected power park modules for which a derogation is requested and the total installed capacity and number of HVDC systems or DC-connected power park modules;

c) the requirement or requirements of this Regulation for which a derogation is requested, with a detailed description of the requested derogation;

d) detailed reasoning, with all relevant supporting documents;

e) demonstration that the requested derogation would have no adverse effect on cross-border trade;

f) a cost-benefit analysis pursuant to the requirements of Article 66. If applicable, the cost-benefit analysis shall be carried out in coordination with the relevant TSO and any adjacent DSOs.

3. Where the request for a derogation is submitted by a relevant DSO or CDSO, the regulatory authority shall, within two weeks from the day after receipt of that request, ask the relevant TSO to assess the request for a derogation in the light of the criteria determined by the regulatory authority pursuant to Article 78.

4. Within two weeks from the day after the receipt of such request for assessment, the relevant TSO shall confirm to the relevant DSO or CDSO whether the request for a derogation is complete. If the relevant TSO considers that it is incomplete, the relevant DSO or CDSO shall submit the required additional information within one month from the receipt of the request for additional information.

5. Within six months of receipt of a request for a derogation, the relevant TSO shall submit to the regulatory authority its assessment, including any relevant documentation. The six-month time limit may



be extended by one month where the relevant TSO seeks further information from the relevant DSO or from the relevant CDSO.

6.The regulatory authority shall adopt a decision concerning a request for a derogation within six months from the day after it receives the request. Where the request for a derogation is submitted by the relevant DSO or CDSO, the six-month time limit runs from the day following receipt of the relevant TSO's assessment pursuant to paragraph 5.

7.The six-month time limit referred to in paragraph 6 may, before its expiry, be extended by an additional three months where the regulatory authority requests further information from the relevant system operator requesting the derogation or from any other interested parties. That additional period shall run from the day following the date of receipt of the complete information. The relevant system operator shall provide any additional information requested by the regulatory authority within two months from the date of the request. If the relevant system operator does not provide the requested additional information within that time limit, the request for a derogation shall be deemed withdrawn unless, before expiry of the time limit:

- a) the regulatory authority decides to provide an extension; or
- b) the relevant system operator informs the regulatory authority by means of a reasoned submission that the request for a derogation is complete.

8.The regulatory authority shall issue a reasoned decision concerning a request for a derogation. Where the regulatory authority grants a derogation, it shall specify its duration.

9.The regulatory authority shall notify its decision to the relevant system operator requesting the derogation, the relevant TSO and the Secretariat and Energy Community Regulatory Board.

10.Regulatory authorities may lay down further requirements concerning the preparation of requests for derogations by relevant system operators. In doing so, regulatory authorities shall take into account the delineation between the transmission system and the distribution system at the national level and shall consult with system operators, HVDC system owners, DC-connected power park module owners and stakeholders, including manufacturers.

11.The regulatory authority may revoke a decision granting a derogation if the circumstances and underlying reasons no longer apply or upon a reasoned recommendation of the Secretariat or reasoned recommendation by the Energy Community Regulatory Board pursuant to Article 83(2).

## **Article 81**

### **Request for derogations from the provisions of Title III by a DC-connected power park module owner**

1.A request for a derogation to the provisions of Article 40(1)(b) and (c), Article 40(2)(a) and (b), and Articles 41 to 45 shall not be subject to Article 79(2)(d) and (e) where it relates to a DC-connected power park module that has, or will have, a single connection to a single synchronous area.

2.The regulatory authority may attach any conditions to a decision concerning request for a derogation referred to in paragraph 1. This may include a condition that the development of the connection into a multi-terminal network, or that connection of a further power park module at the same point, will cause the derogation to be evaluated by the regulatory authority or to expire. The regulatory authority shall take into account the need to optimise the configuration between the DC-connected power park module and the remote-end HVDC converter station, as well as the legitimate expectations of the DC-connected power park module owner when adopting a decision concerning a request for a derogation.

## **Article 82**

### **Register of derogations from the requirements of this Regulation**

1.Regulatory authorities shall maintain a register of all derogations they have granted or refused and shall provide the Energy Community Regulatory Board and the Secretariat with an updated and consolidated register at least once every six months, a copy of which shall be given to ENTSO for Electricity.

2.The register shall contain, in particular:

- a) the requirement or requirements for which the derogation is granted or refused;
- b) the content of the derogation;
- c) the reasons for granting or refusing the derogation;
- d) the consequences resulting from granting the derogation.

## **Article 83**

### **Monitoring of derogations**

1.The Energy Community Regulatory Board and the Secretariat shall monitor the procedure of granting derogations with the cooperation of the regulatory authorities or relevant authorities of the Contracting Party. Those authorities or relevant authorities of the Contracting Party shall provide the Energy Community Regulatory Board and the Secretariat with all the information necessary for that purpose.

2.The Energy Community Regulatory Board may issue a reasoned recommendation to a regulatory authority to revoke a derogation due to a lack of justification. The Secretariat may issue a reasoned recommendation to a regulatory authority or relevant authority of the Contracting Party to revoke a derogation due to a lack of justification.

3.The Secretariat may request the Energy Community Regulatory Board to report on the application of paragraphs 1 and 2 and to provide reasons for requesting or not requesting derogations to be revoked.

## **TITLE VIII FINAL PROVISIONS**

### **Article 84**

#### **Amendment of contracts and general terms and conditions**

- 1.Regulatory authorities shall ensure that all relevant clauses in contracts and general terms and conditions relating to the grid connection of new HVDC systems or new DC-connected power park modules are brought into compliance with the requirements of this Regulation.
- 2.All relevant clauses in contracts and relevant clauses of general terms and conditions relating to the grid connection of existing HVDC systems or existing DC-connected power park modules subject to all or some of the requirements of this Regulation in accordance with paragraph 1 of Article 4 shall be amended in order to comply with the requirements of this Regulation. The relevant clauses shall be amended within three years following the decision of the regulatory authority or Contracting Party as referred to in Article 4(1).
- 3.Regulatory authorities shall ensure that national agreements between system operators and owners of new or existing HVDC systems and DC-connected power park modules subject to this Regulation and relating to grid connection requirements for HVDC systems and DC-connected power park modules, in particular in national network codes, reflect the requirements set out in this Regulation.

### **Article 85**

#### **HVDC System or DC-connected power park modules connecting with synchronous areas or control areas not bound by EU legislation**

- 1.Where an HVDC system to which the requirements of this Regulation apply is connecting synchronous areas or control areas, with at least one synchronous area or one control area not falling under the scope of application of Energy Community legislation, the relevant TSO or, where applicable, the HVDC system owner shall endeavour to implement an agreement to ensure that the owners of HVDC systems with no legal obligation to comply with this Regulation also cooperate to fulfil the requirements.
- 2.If an agreement as referred to in paragraph 1 cannot be implemented, the relevant TSO or, as the case may be, the HVDC system owner concerned shall use all available means to comply with the requirements of this Regulation.

### **Article 86**

#### **Entry into force <sup>9</sup>**

- 1.This regulation enters into force on the twentieth day after its publication in the Official Gazette of the Energy Community. Without contradicting articles 4 (2) (b), 5, 73, 74, and 76, the requirements of this regulation shall apply three years after publication. This Regulation is binding in its entirety and directly applicable in all Contracting Parties of the Energy Community.

This regulation is binding in its entirety and is directly applicable in all Contracting Parties of the Energy Community.

<sup>9</sup>Article 86 shall not be applied based on decision 2018/04/PHLG-EnC

ANNEX I

Frequency ranges referred to in Article 11

Frequency range	Time period for operation
47.0 Hz – 47.5 Hz	60 seconds for each Contracting Party; and 20 seconds for Georgia
47.5 Hz – 48.5 Hz	To be specified by each relevant TSO, but longer than established times for generation and demand according to Regulation (EU) 2016/631 and Regulation (EU) 2016/1388 respectively, and longer than for DC-connected PPMs according to Article 39
48.5 Hz – 49.0 Hz	To be specified by each relevant TSO, but longer than established times for generation and demand according to Regulation (EU) 2016/631 and Regulation (EU) 2016/1388 respectively, and longer than for DC-connected PPMs according to Article 39
49.0 Hz – 51.0 Hz	Unlimited
51.0 Hz – 51.5 Hz	To be specified by each relevant TSO, but longer than established times for generation and demand according to Regulation (EU) 2016/631 and Regulation (EU) 2016/1388 respectively, and longer than for DC-connected PPMs according to Article 39
51.5 Hz – 52.0 Hz	To be specified by each relevant TSO, but longer than for DC-connected PPMs according to Article 39

**Table 1:** Minimum time periods an HVDC system shall be able to operate for different frequencies deviating from a nominal value without disconnecting from the network.

## ANNEX II

Requirements applying to frequency sensitive mode, limited frequency sensitive mode over-frequency and limited frequency sensitive mode underfrequency


### A. Frequency sensitive mode

#### 1. When operating in frequency sensitive mode (FSM):

a) the HVDC system shall be capable of responding to frequency deviations in each connected AC network by adjusting the active power transmission as indicated in Figure 1 and in accordance with the parameters specified by each TSO within the ranges shown in Table 2. This specification shall be subject to notification to the regulatory authority. The modalities of that notification shall be determined in accordance with the applicable national regulatory framework;

b) the adjustment of active power frequency response shall be limited by the minimum HVDC active power transmission capacity and maximum HVDC active power transmission capacity of the HVDC system (in each direction);

**Figure 1**

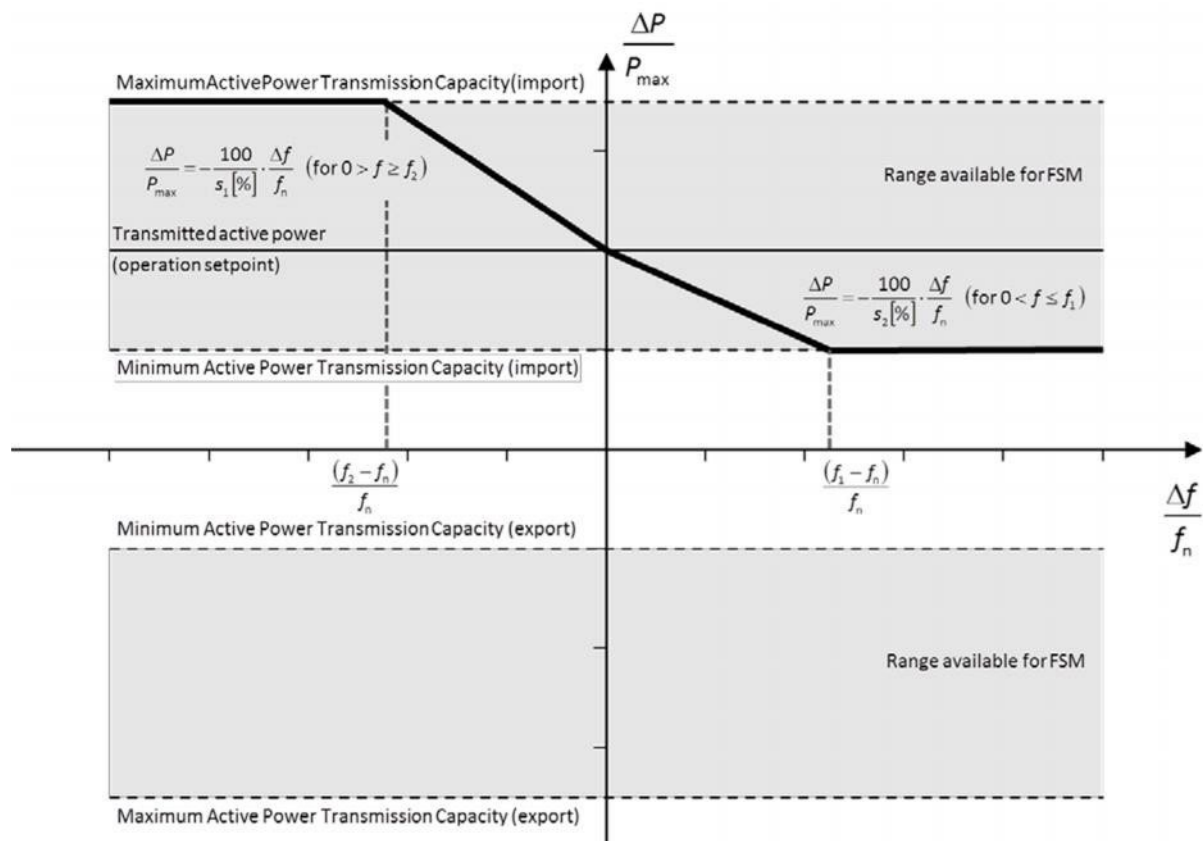

**Figure 1:** Active power frequency response capability of an HVDC system in FSM illustrating the case of zero deadband and insensitivity with a positive active power setpoint (import mode).  $\Delta P$  is the change in active power output from the HVDC system.  $f_n$  is the target frequency in the AC network where the FSM

service is provided and  $\Delta f$  is the frequency deviation in the AC network where the FSM service is provided.

**Table 2:** Parameters for active power frequency response in FSM

Parameters	Ranges
Frequency response deadband	0 – $\pm 500$ mHz
Droop s 1 (upward regulation)	Minimum 0.1%
Droop s 2 (downward regulation)	Minimum 0.1%
Frequency response insensitivity	Maximum 30 mHz

(c) the HVDC system shall be capable, following an instruction from the relevant TSO, of adjusting the droops for upward and downward regulation, the frequency response deadband and the operational range of variation within the active power range available for FSM, set out in Figure 1 and more generally within the limits set by points (a) and (b). These values shall be subject to notification to the regulatory authority. The modalities of that notification shall be determined in accordance with the applicable national regulatory framework;


(d) as a result of a frequency step change, the HVDC system shall be capable of adjusting active power to the active power frequency response defined in Figure 1, in such a way that the response is:

(i) as fast as inherently technically feasible; and

(ii) at or above the solid line according to Figure 2 in accordance with the parameters specified by each relevant TSO within the ranges according to Table 3:

- the HVDC system shall be able to adjust active power output  $\Delta P$  up to the limit of the active power range requested by the relevant TSO in accordance with the times  $t_1$  and  $t_2$  according to the ranges in Table 3, where  $t_1$  is the initial delay and  $t_2$  is the time for full activation. The values of  $t_1$  and  $t_2$  shall be specified by the relevant TSO, subject to notification to the regulatory authority. The modalities of that notification shall be determined in accordance with the applicable national regulatory framework;
- if the initial delay of activation is greater than 0,5 second, the HVDC system owner shall reasonably justify it to the relevant TSO.

**Figure 2**

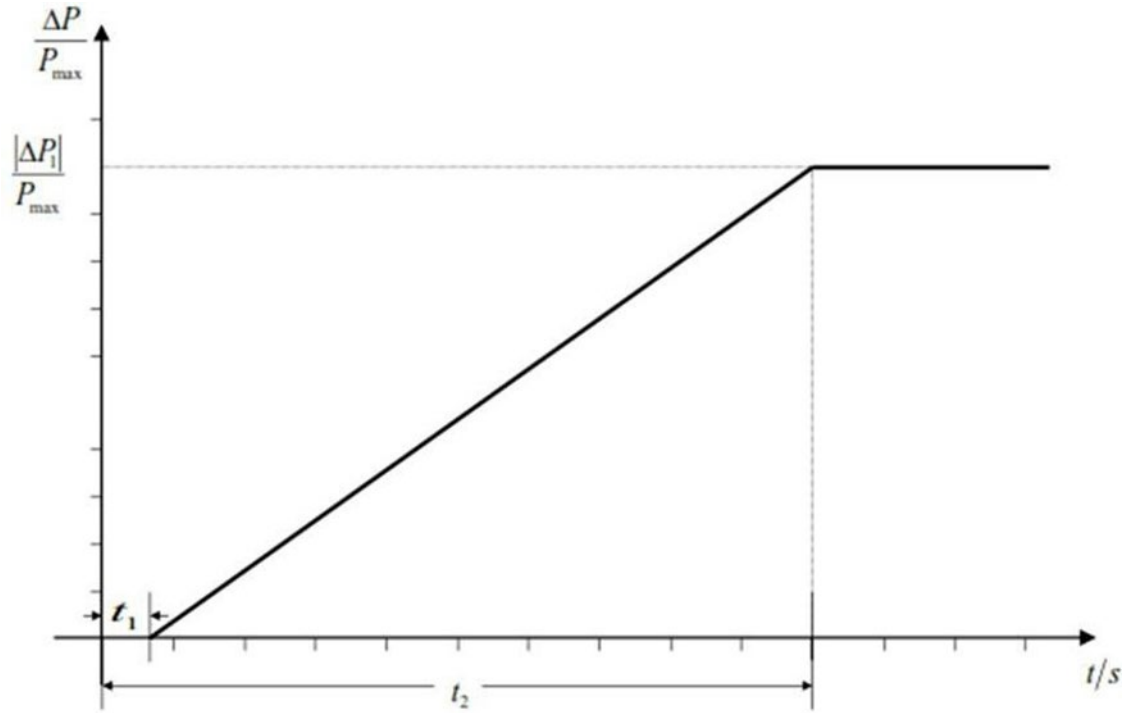

**Figure 2:** Active power frequency response capability of an HVDC system.  $\Delta P$  is the change in active power triggered by the step change in frequency

**Table 3:** Parameters for full activation of active power frequency response resulting from frequency step change.

Parameters	Time
Maximum admissible initial delay $t_1$	0.5 seconds
Maximum admissible time for full activation $t_2$ , unless longer activation times are specified by the relevant TSO	30 seconds

- e) for HVDC systems linking various control areas or synchronous areas, in frequency sensitive mode operation the HVDC system shall be capable of adjusting full active power frequency response at any time and for a continuous time period;

- f) as long as a frequency deviation continues active power control shall not have any adverse impact on the active power frequency response.

#### A. Limited frequency sensitive mode over-frequency

1. In addition to the requirements of Article 11 the following shall apply with regard to limited frequency sensitive mode — over-frequency (LFSM-O):

the HVDC system shall be capable of adjusting active power frequency response to the AC network or networks, during both import and export, according to Figure 3 at a frequency threshold  $f_1$  between and including 50,2 Hz and 50,5 Hz with a droop  $S_3$  adjustable from 0,1 % upwards;


b) the HVDC system shall be capable of adjusting active power down to its minimum HVDC active power transmission capacity;

c) the HVDC system shall be capable of adjusting active power frequency response as fast as inherently technically feasible, with an initial delay and time for full activation determined by the relevant TSO and notified to the regulatory authority in accordance with the applicable national regulatory framework;

d) the HVDC system shall be capable of stable operation during LFSM-O operation. When LFSM-O is active, hierarchy of control functions shall be organized in accordance with Article 35.

5. The frequency threshold and droop settings referred to in point (a) of paragraph 1 shall be determined by the relevant TSO and be notified to the regulatory authority in accordance with the applicable national regulatory framework.

**Figure 3**

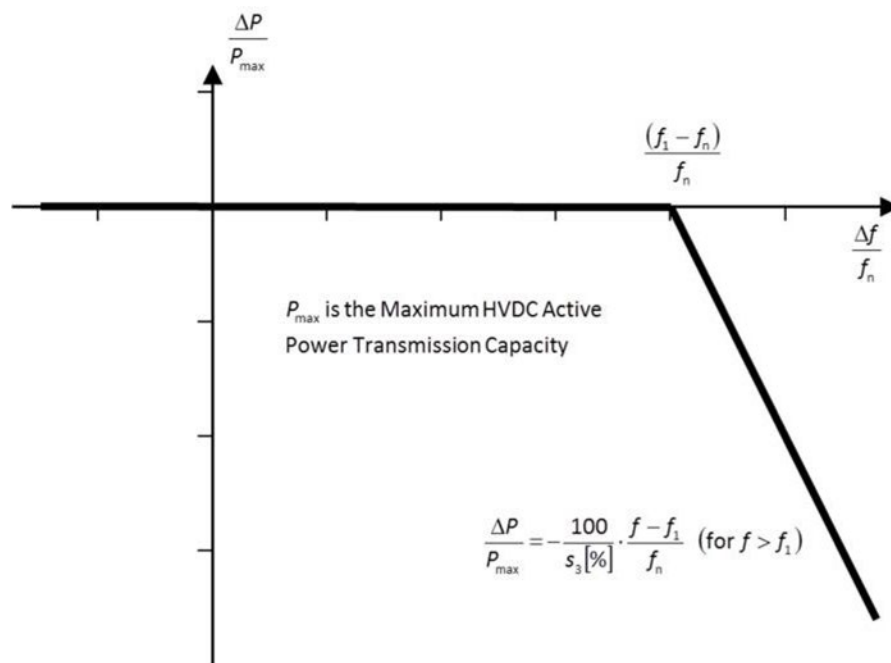

**Figure 3:** Active power frequency response capability of HVDC systems in LFSM-O.  $\Delta P$  is the change in active power output from the HVDC system and, depending on the operational conditions, either a decrease of import power or an increase of export power.  $f_n$  is the nominal frequency of the AC



network or networks the HVDC system is connected to and  $\Delta f$  is the frequency change in the AC network or networks the HVDC is connected to. At over-frequencies where  $f$  is above  $f_1$  the HVDC system shall reduce active power according to the droop setting.

### C. Limited frequency sensitive mode underfrequency

6. In addition to the requirements of Article 11, the following shall apply with regard to limited frequency sensitive mode — underfrequency (LFSM-U):

a) the HVDC system shall be capable of adjusting active power frequency response to the AC network or networks, during both import and export, according to Figure 4 at a frequency threshold  $f_2$  between and including 49,8 Hz and 49,5 Hz with a droop  $S_4$  adjustable from 0,1 % upwards;


b) in the LFSM-U mode the HVDC system shall be capable of adjusting active power up to its maximum HVDC active power transmission capacity;

c) the active power frequency response shall be activated as fast as inherently technically feasible, with an initial delay and time for full activation determined by the relevant TSO and notified to regulatory authority in accordance with the applicable national regulatory framework;

d) the HVDC system shall be capable of stable operation during LFSM-U operation. When LFSM-U is active, hierarchy of control functions shall be organized in accordance with Article 35.

7. The frequency threshold and droop settings referred to in point (a) of paragraph 1 shall be determined by the relevant TSO and be notified to the regulatory authority in accordance with the applicable national regulatory framework.

Figure 4

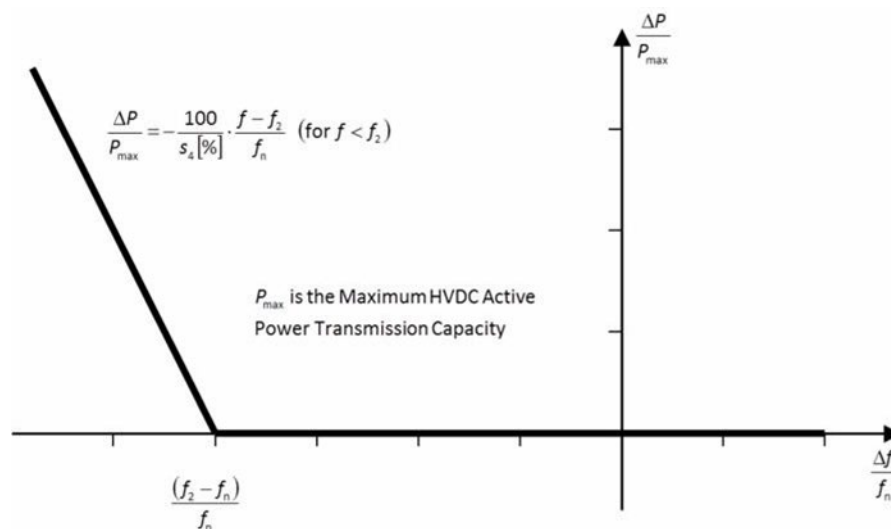

**Figure 4:** Active power frequency response capability of HVDC systems in LFSM-U.  $\Delta P$  is the change in active power output from the HVDC system, depending on the operation condition a decrease of import power or an increase of export power  $f_n$  is the nominal frequency in the AC network or networks the HVDC system is connected and  $\Delta f$  is the frequency change in the AC network or networks the HVDC is connected. At under-frequencies where  $f$  is below  $f_2$ , the HVDC system has to increase active power output according to the droop  $s_4$ .

### ANNEX III

Voltage ranges referred to in Article 18

Synchronous Area	Voltage Range	Time period for operation
Continental Europe	0,85 pu-1,18 pu	Unlimited
	1,18 pu-1,15 pu	To be established by each relevant system operator, in coordination with the relevant TSO but not less than 20 minutes
Nordic	0,90 pu-1,05 pu	Unlimited
	1,05 pu-1,10 pu	60 minutes
Great Britain	0,90 pu-1,10 pu	Unlimited
Ireland and Northern Ireland	0,90 pu-1,18 pu	Unlimited
Baltic, Georgia	0,85 pu-1,18 pu	Unlimited
	1,18 pu-1,15 pu	20 minutes


**Table 4:** Minimum time periods an HVDC system shall be capable of operating for voltages deviating from the reference 1 pu value at the connection points without disconnecting from the network. This table applies in case of pu voltage base values at or above 110 kV and up to (not including) 300 kV.

Synchronous Area	Voltage Range	Time period for operation
Continental Europe	0,85 pu-1,05 pu	Unlimited
	1,05 pu-1,0875 pu	To be specified by each TSO, but not less than 60 minutes
	1,0875 pu-1,10 pu	60 minutes
Nordic	0,90 pu-1,05 pu	Unlimited
	1,05 pu-1,10 pu	To be specified by each TSO, but not more than 60 minutes
Great Britain	0,90 pu-1,05 pu	Unlimited
	1,05 pu-1,10 pu	15 minutes
Ireland and Northern Ireland	0,90 pu-1,05 pu	Unlimited
Baltic, Georgia	0,88 pu-1,097 pu	Unlimited
	1,097 pu-1,15 pu	20 minutes

**Table 5:** Minimum time periods an HVDC system shall be capable of operating for voltages deviating from the reference 1 pu value at the connection points without disconnecting from the network. This table applies in case of pu voltage base values from 300 kV to 400 kV (included).

## ANNEX IV

### Requirements for U-Q/P<sub>max</sub>-profile referred to in Article 20

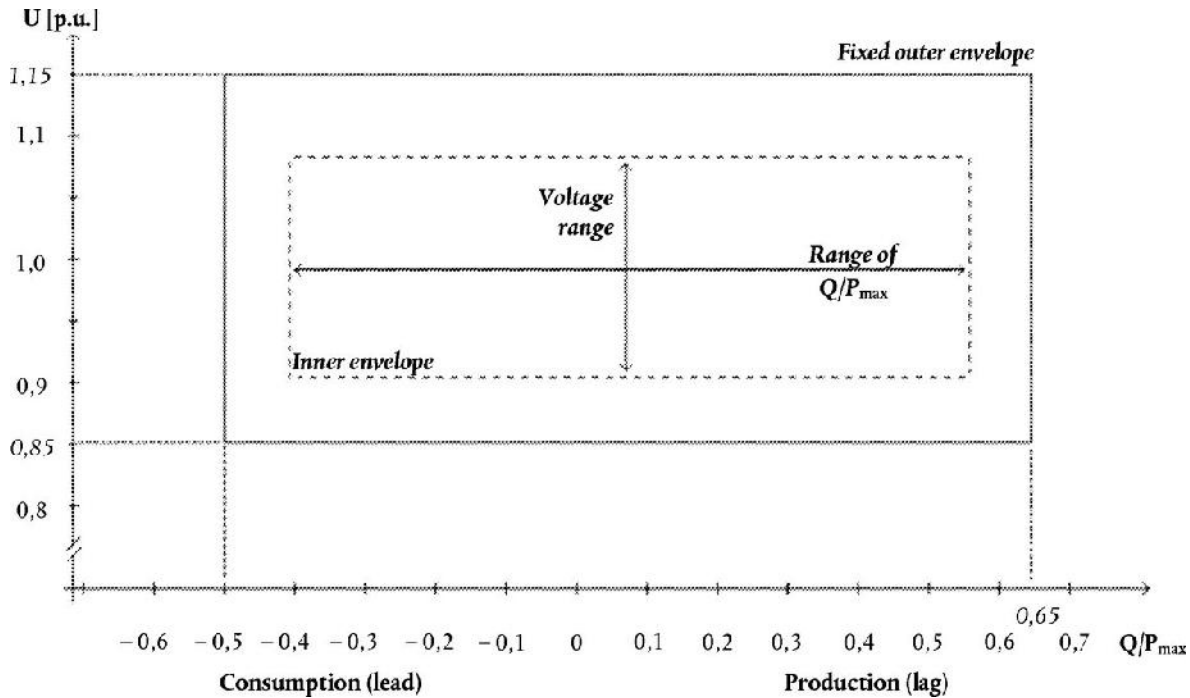


**Figure 5:** The diagram represents boundaries of a U-Q/P<sub>max</sub>-profile with U being the voltage at the connection points expressed by the ratio of its actual value to its reference 1 pu value in per unit, and Q/P<sub>max</sub> the ratio of the reactive power to the maximum HVDC active power transmission capacity. The position, size and shape of the inner envelope are indicative and shapes other than rectangular may be used within the inner envelope. For profile shapes other than rectangular, the voltage range represents the highest and lowest voltage points in this shape. Such a profile would not give rise to the full reactive power range being available across the range of steady-state voltages.

Synchronous Area	Maximum range of Q/P <sub>max</sub>	Maximum range of steady-state Voltage level in PU
Continental Europe	0,95	0,225
Nordic	0,95	0,15
Great Britain	0,95	0,225
Ireland and Northern Ireland	1,08	0,218
Baltic States, Georgia	1,0	0,220

**Table 6:** Parameters for the Inner Envelope in the Figure.

## ANNEX V

### Voltage-against-time-profile referred to in Article 25

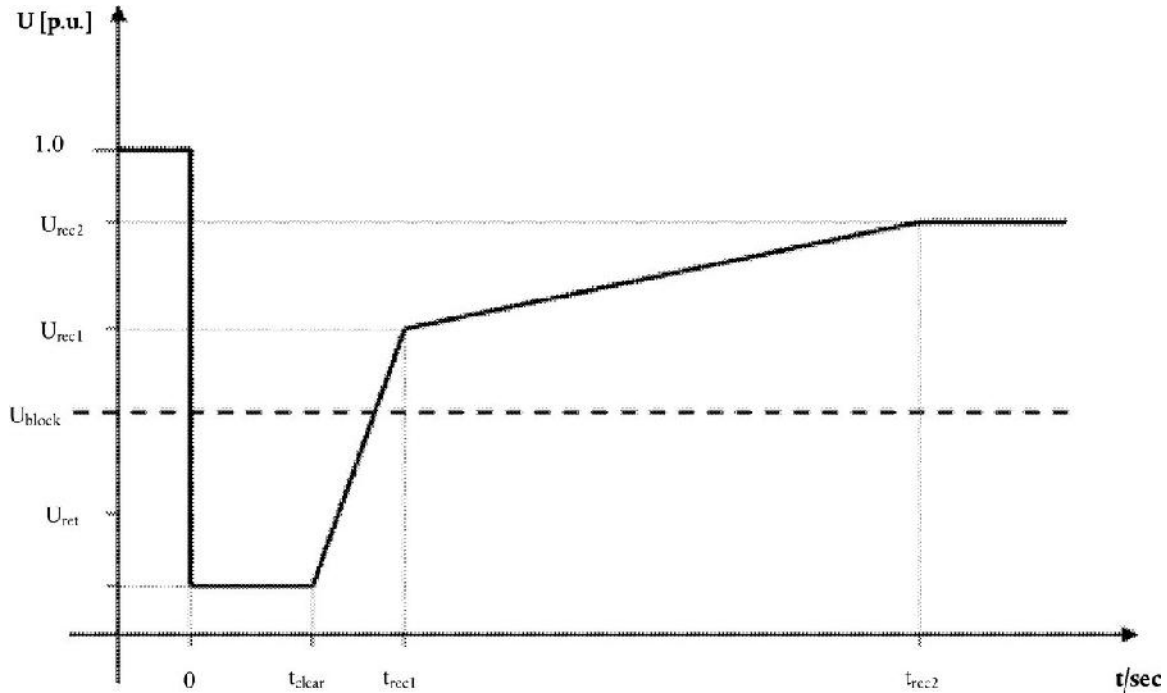

**Figure 6:** Fault-ride-through profile of an HVDC converter station. The diagram represents the lower limit of a voltage-against-time profile at the connection point, expressed by the ratio of its actual value and its reference 1 pu value in per unit before, during and after a fault.  $U_{ret}$  is the retained voltage at the connection point during a fault,  $t_{clear}$  is the instant when the fault has been cleared,  $U_{rec1}$  and  $t_{rec1}$  specify a point of lower limits of voltage recovery following fault clearance.  $U_{block}$  is the blocking voltage at the connection point. The time values referred to are measured from  $t_{fault}$ .

Voltage parameters [pu]		Time parameters [seconds]	
$U_{ret}$	0,00-0,30	$t_{clear}$	0,14-0,25
$U_{rec1}$	0,25-0,85	$t_{rec1}$	1,5-2,5
$U_{rec2}$	0,85-0,90	$t_{rec2}$	$T_{rec1}-10,0$

**Table 7:** Parameters for Figure 6 for the fault-ride-through capability of an HVDC converter station.

## ANNEX VI

### Frequency ranges and time periods referred to in Article 39(2)(a)

Frequency range	Time period for operation
47,0 Hz-47,5 Hz	20 seconds
47,5 Hz-49,0 Hz	90 minutes
49,0 Hz-51,0 Hz	Unlimited
51,0 Hz-51,5 Hz	90 minutes
51,5 Hz-52,0 Hz	15 minutes

**Table 8:** Minimum time periods for the 50 Hz nominal system for which a PPM shall be capable of operating for different frequencies deviating from a nominal value without disconnecting from the network.

## ANNEX VII


### Voltage ranges and time periods referred to in Article 40

Voltage Range	Time period for operation
0,85 pu-0,90 pu	60 minutes
0,90 pu-1,10 pu	Unlimited
1,10 pu-1,118 pu	Unlimited, unless specified otherwise by the relevant system operator, in coordination with the relevant TSO.
1,118 pu-1,15 pu	To be specified by the relevant system operator, in coordination with the relevant TSO.

**Table 9:** Minimum time periods for which a DC-connected power park module shall be capable of operating for different voltages deviating from a reference 1 pu value without disconnecting from the network where the voltage base for pu values is from 110 kV to (not including) 300 kV.

Voltage Range	Time period for operation
0,85 pu-0,90 pu	60 minutes
0,90 pu-1,05 pu	Unlimited
1,05 pu-1,15 pu	To be specified by the relevant system operator, in coordination with the relevant TSO. Various sub-ranges of voltage withstand capability can be specified.

**Table 10:** Minimum time periods for which a DC-connected power park module shall be capable of operating for different voltages deviating from a reference 1 pu value without disconnecting from the network where the voltage base for pu values is from 300 kV to 400 kV (included).

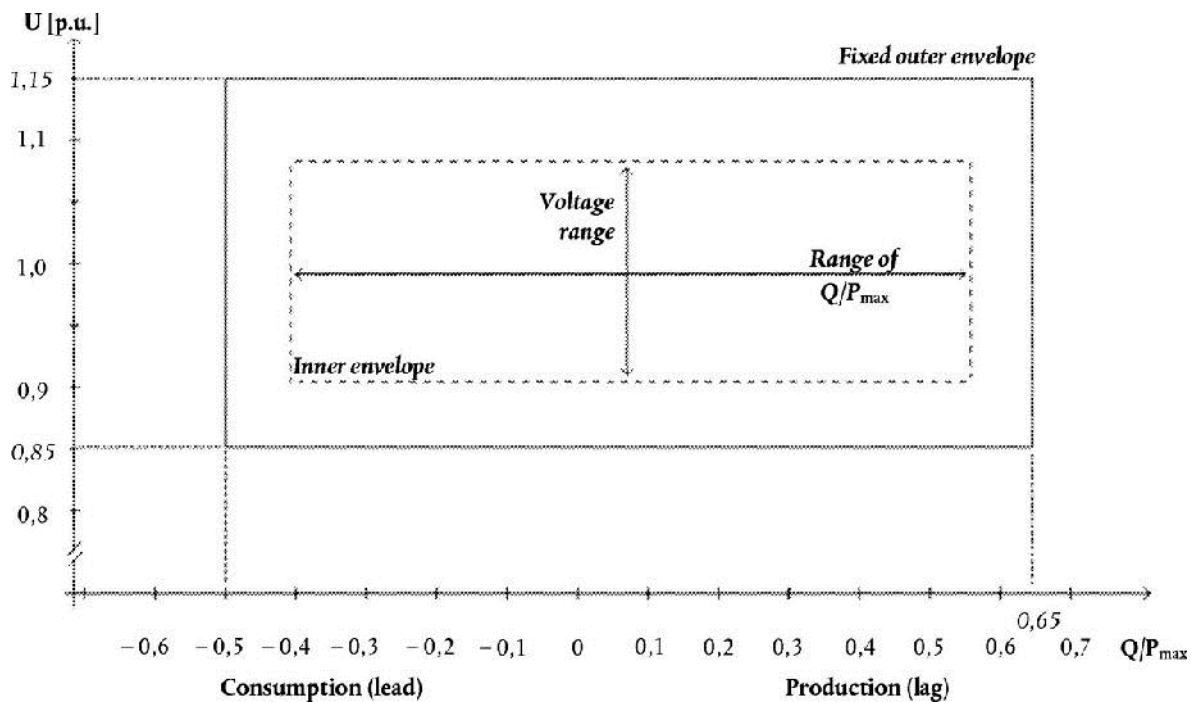

**Figure 7:** U-Q/P<sub>max</sub>-profile of a DC-connected power park module at the connection point. The diagram represents boundaries of a U-Q/P<sub>max</sub>-profile of the voltage at the connection point[s], expressed by the ratio of its actual value to its reference 1 pu value in per unit, against the ratio of the reactive power (Q) to the maximum capacity (P<sub>max</sub>). The position, size and shape of the inner envelope are indicative and other than rectangular may be used within the inner envelope. For profile shapes other than rectangular, the voltage range represents the highest and lowest voltage points. Such a profile would not give rise to the full reactive power range being available across the range of steady-state voltages.

Range of width of Q/Pmax profile	Range of steady-state Voltage level in pu
0-0,95	0,1-0,225

**Table 11:** Maximum and minimum range of both Q/Pmax and steady-state voltage for a DC-connected PPM



## ANNEX VIII

### Reactive power and voltage requirements referred to in Article 48

Voltage range	Time period for operation
0,85 pu-0,90 pu	60 minutes
0,90 pu-1,10 pu	Unlimited
1,10 pu-1,12 pu	Unlimited, unless specified otherwise by the relevant system operator, in coordination with the relevant TSO.
1,12 pu-1,15 pu	To be specified by the relevant system operator, in coordination with the relevant TSO.

**Table 12:** Minimum time periods for which a remote-end HVDC converter station shall be capable of operating for different voltages deviating from a reference 1 pu value without disconnecting from the network where the voltage base for pu values is from 110 kV to (not including) 300 kV.

Voltage range	Time period for operation
0,85 pu-0,90 pu	60 minutes
0,90 pu-1,05 pu	Unlimited
1,05 pu-1,15 pu	To be specified by the relevant system operator, in coordination with the relevant TSO. Various sub-ranges of voltage withstand capability may be specified.

**Table 13:** Minimum time periods for which a remote-end HVDC converter station shall be capable of operating for different voltages deviating from a reference 1 pu value without disconnecting from the network where the voltage base for pu values is from 300 kV to 400 kV (included).

Maximum range of Q/Pmax	Maximum range of steady-state voltage level in PU
0,95	0,225

**Table 14:** Maximum range of both Q/Pmax and steady-state voltage for a remote-end HVDC converter station.